DLFSDA and **DLFLDA**

OWNERS MANUAL

Ducted Style Ductless System - Sizes 09 to 58

TABLE OF CONTENTS

	PAGE				
A NOTE ABOUT SAFETY					
GENERAL					
PARTS LIST					
BUTTON FUNCTIONS	4				
CLEANING, MAINTENANCE, AND TROUBLESHOOTING					
NOTE TO EQUIPMENT OWNER:					
Please read this Owner's Information Manual carefully before installing and using this appliance and keep this manual for future reference.					
For your convenience, please record the model and serial numbers of your new equipment in the spaces provided. This information, along with the installation data and dealer contact information, will be helpful should your system require maintenance or service.					
UNIT INFORMATION	DEALERSHIP CONTACT INFORMATION				
Model #	Company Name:				
Serial #	Address:				
INSTALLATION INFORMATION	Phone Number:				
Date Installed	Technician Name:				

A NOTE ABOUT SAFETY

Any time you see this symbol \triangle in manuals, instructions and on the unit, be aware of the potential for personal injury. There are three levels of precaution:

DANGER identifies the most serious hazards which will result in severe personal injury or death.

WARNING signifies hazards that could result in personal injury or death.

CAUTION is used to identify unsafe practices which could result in minor personal injury or product and property damage.

NOTE is used to highlight suggestions which will result in enhanced installation, reliability, or operation.

A WARNING

PERSONAL INJURY, DEATH AND / OR PROPERTY DAMAGE HAZARD

Failure to follow this warning could result in personal injury, death or property damage.

Improper installation, adjustment, alteration, service, maintenance, or use can cause explosion, fire, electrical shock, or other conditions which may cause personal injury or property damage. Consult a qualified installer, service agency, or your distributor or branch for information or assistance. The qualified installer or service agency must use factory—authorized kits or accessories when modifying this product.

Read and follow all instructions and warnings, including labels shipped with or attached to unit before operating your new air conditioner.

GENERAL

The ducted fan coil unit provides quiet, maximum comfort. In addition to cooling and/or heating, the ducted fan coil unit matched with an outdoor condensing unit filters and dehumidifies the air in the room to provide maximum comfort.

IMPORTANT: The ducted fan coil unit should be installed by authorized personnel only; using approved tubing and accessories. If technical assistance, service or repair is needed, contact the installer. The ducted fan coil unit can be set up and operated from the remote control (provided). If the remote is misplaced, the system can be operated from the "Auto" setting on the unit.

OPERATING MODES

The ducted fan coil unit has five operating modes:

- Fan only
- Δ 11fe
- Heating (heat pump models only)
- Cooling
- Dehumidification (DRY)

Fan Only

In **FAN ONLY** mode, the system filters and circulates the room air without changing room air temperature.

Auto

In **AUTO** mode, the system automatically cools or heats the room according to the user–selected set point.

NOTE: AUTO mode is recommended for use on single zone applications only. Using Auto changeover on multi–zone applications could set an indoor unit to STANDBY mode, indicated with two dashes (—) on the display, which will turn off the indoor unit until all the indoor units are in the same mode (COOLING or HEATING). Heating is the system's priority mode. Simultaneous HEATING and COOLING is not allowed.

Heating

In **HEATING** mode, the system heats and filters the room air.

Cooling

In COOLING mode, the system cools, dries and filters the room air.

Dehumidification (DRY)

In **DEHUMIDIFICATION** mode, the system dries, filters and slightly cools the room air temperature. This mode prioritizes air dehumidification but it *does not* take the place of a dehumidifier.

WIRELESS REMOTE CONTROL

The remote control transmits commands to set up and operate the system. The control has a window display panel that displays the current system status. The control can be secured to a surface when used with the mounting bracket provided.

WIRED REMOTE CONTROL (OPTIONAL)

PARTS LIST



PART NAME
INDOOR UNIT
DRAIN ADAPTER
AIR FILTER
WIRED CONTROLLER
WIRELESS REMOTE

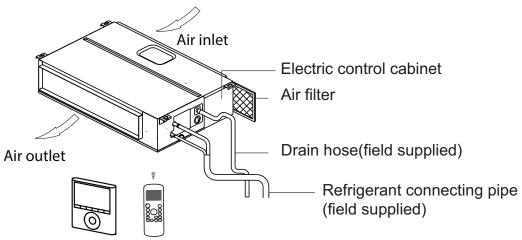


Fig. 1 - Parts List

NOTE: Images are for illustration purposes only.

DISPLAY PANEL

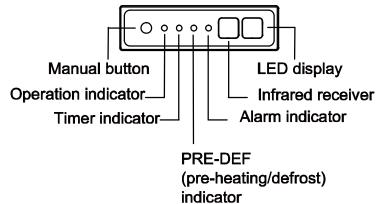


Fig. 2 – IR (Infrared) receiver Display Panel

BUTTON FUNCTIONS

Before you begin using your new air conditioner, make sure to familiarize yourself with the remote control. The following is a brief introduction to the remote control.

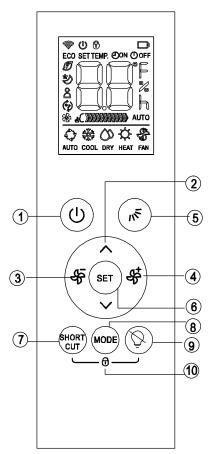


Fig. 3 - Remote Controller Buttons

1. ON/OFF Button ((1))

This button turns the unit ON and OFF.

2. UP Button ($\stackrel{\bigstar}{}$) and DOWN Button ($\stackrel{\bigstar}{}$)

Press these buttons to increase or decrease the set temperature or Timer setting hours.

3. Fan Button ()

Used to select the fan speed in four steps:

NOTE:

Hold down this button for at least 2 seconds to activate/cancel Silent mode. Due to low frequency operation of the compressor, it may result in insufficient cooling and heating capacity.

4. Fan Button (学)

Used to select the fan speed in four steps:

You cannot switch the fan speed in AUTO or DRY mode.

NOTE: Hold down this button for at least 2 seconds to activate/cancel Turbo mode. Turbo function enables the unit to reach the preset temperature at cooling or heating operation in the shortest time. If the indoor unit does not support this function, there is no corresponding operation happening when this button is pressed.

Used to stop or start horizontal louver movement. Hold down this button for 2 seconds to start/stop vertical louver movement. Not available on this system.

6. Set Button

Used to initiate the following functions in the sequence below, in conjunction with the \wedge and \vee buttons.

(* Indicates optional functions)

Press the SET button to select the desired function. The selected symbol will flash on the display area. Then press the ^ or

button to confirm.

This function maintains the most comfortable temperature and saves energy. It is available in COOL, HEAT, or AUTO modes only

For details, see sleep operation in the USERS MANUAL.

* FRESH Function ()

Not available on this system.

* SELF CLEAN Function (() (optional)

In SELF CLEAN mode, the unit automatically cleans and dries the Evaporator and keeps it fresh for the next operation.

* FOLLOW ME Function () (optional)

When the Follow Me function is activated, the remote display is the actual temperature at its location. The remote control will send this signal to the unit every 3 minutes until the FOLLOW ME button is pressed again.

7. Shortcut Button

- Used to restore the current settings or resume previous settings.
- The first time connecting to power, if the SHORTCUT button is pressed, the unit will operate in AUTO mode, 80°F, and the fan speed is Auto.
- Push this button when the remote controller is on, and the system automatically reverts back to the previous settings including operating mode, setting temperature, fan speed level, and sleep feature (if activated).
- If this button is pressed more than 2 seconds, the system automatically restores the current operation settings including operating mode, setting temperature, fan speed level, and sleep feature (if activated).

8. Mode Button

Press this button to modify the unit mode in the following sequence:

9. LED Button ()

Press this button to turn ON/OFF the indoor screen display.

NOTE: Pressing and holding the LED and SWING buttons together for 3 seconds will alternate the temperature display between °C and °F scales.

10. LOCK Function

Press SHORT CUT and LED buttons together to lock or unlock the keyboard.

MODE DISPLAY

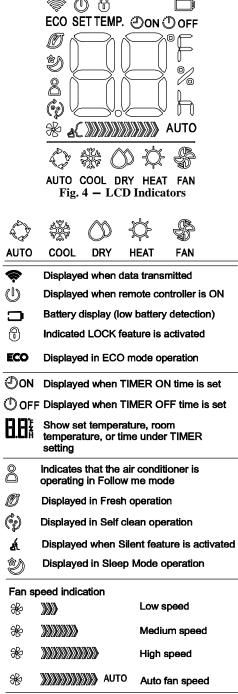


Fig. 5 - Mode Display

NOTE: All indicators shown in the figure are for the purpose of clear presentation. During the actual operation, only the relative functional signs are shown in the display window.

REMOTE CONTROL

A CAUTION

EOUIPMENT DAMAGE HAZARD

Failure to follow this caution may result in equipment damage.

Handle the control with care and avoid getting the control wet.

IMPORTANT: The remote control can operate the unit from a distance of up to 26 ft. (8 m) as long as there are no obstructions. When the timer function is used, the remote control should be kept in the vicinity of the fan coil (within 26 ft. / 8 m).

The remote control can perform the following basic functions:

- Turn the system ON and OFF
- Select operating mode
- Adjust room air temperature set point and fan speed
- Adjust airflow direction

Refer to the *Remote Control Function* section for a detailed description of all the capabilities of the remote control.

Battery Installation

Two AAA 1.5v alkaline batteries (included) are required for operation of the remote control.

To install or replace batteries:

- Slide the back cover off the control to open the battery compartment.
- Insert batteries. Follow the polarity markings inside the battery compartment.
- Replace the battery compartment cover.

NOTE:

- 1. When replacing batteries, do not use old batteries or a different type battery. This may cause the remote control to malfunction.
- 2. If the remote is not going to be used for several weeks, remove the batteries. Otherwise battery leakage may damage the remote control.
- 3. The average battery life under normal use is about 6 months.
- Replace the batteries when there is no audible beep from the indoor unit or if the Transmission Indicator fails to light.
- When batteries are removed, the remote control erases all programmed settings. The control must be reprogrammed after insertion of new batteries.

Remote Control Operation - Quick Start

NOTE: When transmitting a command from the remote control to the unit, be sure to point the control toward the right side of the unit. The unit confirms receipt of a command by sounding an audible beep.

- 1. Turn the unit on by pushing the ON/OFF button.
- 2. If there is a preference for °C rather than °F (default), press and hold the increase ▲ and decrease ▼ temperature set point buttons together for approximately 3 seconds.
- 3. Select the desired mode by pushing the mode button.



Fig. 6 - Modes

- 4. Select the temperature set point by pointing the control toward the unit and pressing the increase/decrease temperature set point buttons until the desired temperature appears on screen.
- 5. Select the desired fan speed by pressing the FAN button.

NOTE: If the unit is operating in DRY or AUTO mode, the fan speed will be automatically set.

Manual Operation

If the remote control is lost, damaged, or the batteries are exhausted, the MANUAL button can be used to run the unit. When the MANUAL button is pressed once, the AUTO mode takes affect (heat or cool). When this button is pressed twice, the system enters the TEST mode and runs for 30 minutes in the COOLING mode (it runs in AUTO mode afterward).

When pressed three times, the system turns OFF.




Fig. 7 - - IR Receiver Display Panel

The set conditions of manual operation are as follows:

• Preset set point: 76°F (24°C)

• Fan speed: AUTO

 Discharge air direction: Pre-set position based on operation in COOL or HEAT mode

REMOTE CONTROL FUNCTIONS

Pressing the On/Off Button


When the air conditioner is not in operation, the remote control displays the last set point and mode.

- Press ON/OFF to start the unit.
- The unit starts in the last operating mode and set point. The ON/OFF indicator appears.
- Press **On/Off** to stop the unit.
 - All the indicator lights on the unit go out, and the remote control displays the set point and mode.

NOTE: If the On/Off button is pressed too soon after a stop, the compressor will not start for 3 to 4 minutes due to the inherent protection against frequent compressor cycling. The unit only emits an audible beep when the signals are received correctly.

Selecting an Operating Mode

NOTE: Use OPERATING mode to select one of the available modes.




Setting the Room Temperature Set Point

Press the increase temperature set point \triangle and decrease ∇ buttons to raise or lower the temperature.

The unit confirms the signal receipt with a beep and the value of the set temperature appears on the display and changes accordingly. The temperature can be set between 62°F (17°C) and 86°F (30°C) in increments of 1°F or 1°C.

NOTE: In the COOLING mode, if the temperature selected is higher than the room temperature, the unit will not start. The same applies for the HEATING mode if the selected temperature is lower than the room temperature.

Selecting the Fan Speed



The fan speed can be selected by pressing FAN.

NOTE: When the unit is on, the fan runs continuously in cooling or heating. When in heating, there might be situations where the fan will slow down or shut off to prevent cold blow.

Selecting the Up - Down Airflow Louver Position

To optimize comfort, the horizontal louver should be adjusted as shown below.

AUTO OPERATION

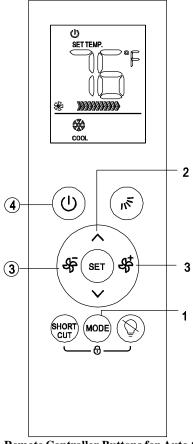


Fig. 10 - Remote Controller Buttons for Auto Operation

Ensure the unit is plugged in and power is available. The OPERATION indicator on the display panel of the indoor unit starts flashing.

- 1. Press the MODE button to select Auto.
- 2. Press the UP/DOWN button to set the desired temperature. The temperature can be set within a range of 62°F~86°F in 1°F increments.
- 3. Press the ON/OFF button to start the unit.

NOTE:

- In Auto mode, the unit can logically choose the mode of Cooling, Fan, and Heating by sensing the difference between the actual ambient room temperature and the setting temperature on the remote controller.
- In Auto mode, you cannot switch the fan speed. It has already been automatically controlled.
- If Auto mode is not comfortable for you, the desired mode can be manually selected.

Cooling / Heating / Fan Operation

Ensure the unit is plugged in and power is available.

- Press the MODE button to select COOL, HEAT (cooling and heating models only), or FAN mode.
- Press the UP/DOWN buttons to set the desired temperature. The temperature can be set within a range of 62°F~86°F in 1°F increments.
- Press the FAN button to select the fan speed in four steps- Auto, Low, Med, or High.
- 4. Press the ON/OFF button to start the unit.

NOTE: In FAN mode, the setting temperature is not displayed on the remote controller and you are not able to control the room temperature. In this case, only steps 1, 3, and 4 may be performed.

DEHUMIDIFYING OPERATION

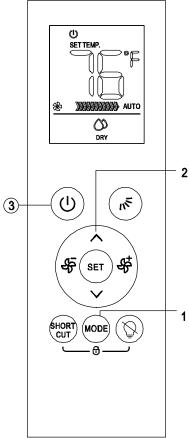


Fig. 11 — Remote Controller Buttons for Dehumidifying Operation

Ensure the unit is plugged in and power is available. The OPERATION indicator on the display panel of the indoor unit starts flashing.

- 1. Press the MODE button to select DRY mode.
- Press the UP/DOWN buttons to set the desired temperature. The temperature can be set within a range of 62°F~86°F in 1°F increments.
- 3. Press the ON/OFF button to start the unit.

TIMER OPERATION

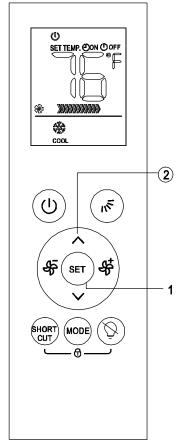


Fig. 12 - Remote Controller Buttons for Timer Operation

Press the SET button can set the auto-on/off time of the unit.

Set the Auto-On Time

1. Press the SET button

The Timer on indicator ON displays and flashes. The last Auto-on setting time and the signal "h" shows on the LCD display area. Now it is ready to reset the Auto-on time to START the operation.

- 2. Press the ∧ or ∨ button to set desired Auto-On time. Each time you press the button, the time increases/decreases by half an hour between 0 and 10 hours and by one hour between 10 and 24 hours.
- 3. Once the desired time is established, there will be a three second delay before the remote controller transmits the signal to the unit. Then, the "h" signal disappears, and the Timer On indicator will remain on and the set temperature will re–appear on the LCD display window.

Set the Auto-Off Time

- 1. Press the SET button until the Timer On indicator Ooff displays and flashes. The last Auto-off setting time and the "h" signal will be shown on the LCD display area. Now it is ready to reset the Auto-off time to STOP the operation.
- Press the o or ✓ button to set desired Auto-On time. Each time you press the button, the time increases/decreases by half an hour between 0 and 10 hours and by one hour between 10 and 24 hours
- 3. Once the desired time is established, there will be a three second delay before the remote controller transmits the signal to the unit. Then, the "h" signal disappears, and the Timer Off indicator will remain on and the set temperature will re—appear on the LCD display window.

Timer Setting Example




Fig. 13 – Timer ON Setting Example

(Auto-ON Operation)


The TIMER ON feature is useful when you want the unit to turn on automatically before you return home. The unit will automatically start operating at the set time.

Example

To start the unit in 6 hours.

- Press the SET button to select TIMER ON.
 The last setting of starting operation time and signal "h" will show on the display area.
- Press the or button to display "6.0h" on the TIMER ON display
 of the remote controller.
- Wait for three seconds and the digital display area will show the temperature again. The OoN indicator remains on and this function is activated.

Timer OFF



(Auto-OFF Operation)

The TIMER OFF feature is useful when you want the unit to turn off automatically after you go to bed. The unit will stop automatically at the set time.

Example

To sop the unit in 10 hours.

- Press the SET button to select TIMER OFF.
 The last setting of stopping operation time and the signal "h" will show on the display area.
- 2. Press the ∧ or ∨ button to display "10h" on the TIMER OFF display of the remote controller.
- 3. Wait for three seconds and the digital display area will show the temperature again. The Ooff indicator remains on and this function is activated.

Combined Timer

(Setting both ON and OFF timers simultaneously)

TIMER OFF \rightarrow TIMER ON (On \rightarrow Stop \rightarrow Start operation)






Fig. 15 — Combined Timer (Timer OFF → Timer ON)

This feature is useful when you want to stop the unit in the evening, and start it again in the morning.

Example

To stop the unit 2 hours after setting and start it again 10 hours after setting.

- 1. Press the SET button to select TIMER OFF.
- Press the or button to display "2.0h" on the TIMER OFF display.
- 3. Press the SET button to select TIMER ON.
- 4. Press \wedge or \vee button to display "10h" on the TIMER ON display .
- Wait three seconds and the digital display area will show the temperature again. The OoN and Ooff indicators remain on and this function is activated.

TIMER ON \rightarrow TIMER OFF (Off \rightarrow Start \rightarrow Stop operation)






Fig. 16 - Combined Timer (Timer ON → Timer OFF)

This feature is useful when you want to start the unit before waking up and stopping it after leaving the house.

Example

To start the unit 2 hours after setting and stop it 5 hours after setting.

- 1. Press the SET button to select TIMER ON.
- Press the or button to display "2.0h" on the TIMER ON display.
- 3. Press the SET button to select TIMER OFF.
- 4. Press the \wedge or \checkmark button to display "5.0h" on the TIMER OFF display.
- Wait three seconds, and the digital display area will show the temperature again.

The **Ook** and **Ooff** indicators remain on and this function is activated.

Sleep Mode

SLEEP mode is used to conserve energy and can be used when the unit is in the **COOL**, **HEAT** or **AUTO** mode only.

Cool Mode

a. Push SLEEP. After 1 hour the set point raises by 1.8°F (1°C). After another hour, the set point raises by another 1.8°F (1°C) and the fan runs in a low speed. The unit shuts off 5 hours after setting the SLEEP mode. The SLEEP mode cancels if either MODE, TEMP, FAN, TIMER, or ON/OFF on the remote control are pressed.

Heat Mode

Same as cooling mode however set points are lowered by 1.8°F (1°C).

Turbo Mode

Use the TURBO mode to cool or heat the room rapidly.

a. Press TURBO. An audible "beep" is heard if the indoor unit supports this function. The fan runs on super high speed. The TURBO mode terminates automatically 20 minutes after pushing TURBO. It can be terminated immediately by selecting TURBO again. When the TURBO mode is terminated, the unit reverts to the original setting.

Self Clean Mode

Press CLEAN to activate or deactivate the self-cleaning function. Under this function, the air conditioner automatically cleans and dries the evaporator. The cleaning cycle takes 16 minutes, after which the unit turns off automatically. Pressing CLEAN in the middle of the cycle cancels the operation and turns off the unit. This function can be activated only in the COOL or DRY mode.

Follow Me Mode

Press **Follow Me** to activate or deactivate this function. Under this setting, the temperature that appears in the remote control is the actual temperature at its location. The remote control sends this signal to the air conditioner every 3 minutes. This function is not available for **DRY** and **FAN** modes.

Freeze Protection Mode

Press **FP** for approximately 2 seconds to activate or deactivate the freeze protection mode (heating set back). The indoor unit displays "FP".

NOTE: This function is only available in the heating mode.

Under this function, the unit operates at high fan speed and the coil temperature automatically sets to $46^{\circ}F$ ($8^{\circ}C$). This mode can also be deactivated by pressing **ON/OFF**, **SLEEP**, **MODE**, **FAN**, or either **TEMP**.

Silence Mode

NOTE: The Silence Mode (SLC) feature is not available on this model.

LED Light

Press LED to turn the display light on and off.

Resetting the Remote Control

If the batteries in the remote control are removed, the current settings will be cancelled and the control returns to the initial settings and will be in standby mode. Push **ON/OFF** to activate.

Time Delay

If **ON/OFF** is pressed too soon after a stop, the compressor will not start for 3 to 4 minutes due to the inherent protection against frequent compressor cycling. The unit only emits an audible beep when the signals are received correctly.

Heating Features

If the unit is in the heating mode, there is a delay when the fan starts. The fan starts only after the coil is warmed up to prevent cold blow.

Auto Defrost Operation

In **HEATING** mode, if the outdoor coil is frosted, the indoor fan and outdoor fan turns off while the system removes the frost from the outdoor coil. The system automatically reverts to normal operation when frost is removed from the outdoor unit.

Auto Start

If the power fails while the unit is operating, the unit stores the operating condition, and the unit will start operation automatically under those conditions when the power is restored.

CLEANING, MAINTENANCE, AND TROUBLESHOOTING

A CAUTION

ELECTRICAL SHOCK HAZARD

Failure to follow this caution may result in personal injury or death.

Always turn off power to the system before performing any cleaning or maintenance to the system. Turn off the outdoor disconnect switch located near outdoor unit. Be sure to disconnect indoor unit if on a separate switch

A CAUTION

EQUIPMENT DAMAGE/OPERATION HAZARD

Failure to follow this caution may result in equipment damage or improper unit operation.

Operating the system with dirty air filters may damage the indoor unit and could cause reduced cooling performance, intermittent system operation, frost build—up on indoor coil or blown fuses.

PERIODIC MAINTENANCE

Periodic maintenance is recommended to ensure proper operation of the unit. Recommended maintenance intervals may vary depending on the installation environment, e.g., dusty zones. Refer to Table 2.

A CAUTION

CUT HAZARD

Failure to follow this caution may result in personal injury.

The coil fins are very sharp. Use caution when cleaning.

Always wear safety protection.

Cleaning the Coil

Clean the coil at the beginning of each cooling season or when necessary. Use a vacuum cleaner or a long-bristle brush to avoid damage to the coil fins.

Air Filters

Remove and clean the air filters once a month.

NOTE: If the air filters show signs of excessive wear or are torn, they must be replaced. Contact your local dealer for replacement filters.

- 1. Unscrew filters from the frame.
- 2. Pull filters down to remove.

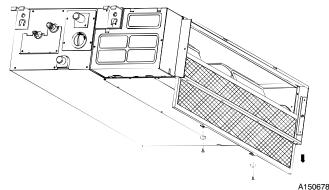


Fig. 17 — Remove the Filters

3. Vacuum filters.





Fig. 18 - Vacuum the Filters

A150648

4. Clean with warm water.



A150649

Fig. 19 - Clean Filter with Warm Water

- 5. Shake filter to remove excess water and dry thoroughly.
- 6. Replace filter by sliding into rack until filter snaps in place.
- 7. Close front panel on unit.

CAUTION

EQUIPMENT DAMAGE HAZARD

Failure to follow this caution may result in equipment damage.

When cleaning the front panel, do not use water hotter than $105\,^{\circ}$ F ($40.6\,^{\circ}$ C) and do not pour water onto the fan coil. Do not use abrasive or petroleum based cleaners as they may damage the front panel.

Preparing for Extended Shutdown Period

Clean the filters and place them back in the unit. Operate the unit in **FAN ONLY** mode for 12 hours to dry all internal parts. Turn the main power supply off and remove the batteries from the remote control.

System Operation Recommendations

The items outlined in the following list help to ensure proper system operation:

- Replace both remote control batteries.
- Point the remote control toward the unit display panel when transmitting a command.
- Keep doors and windows closed while the unit is operating.
- Contact an authorized service representative if a problem arises that cannot be easily resolved.
- Do not perform cleaning or maintenance while the unit is on.
- Keep the display panel on the unit away from direct sunlight and heat as this may interfere with remote control transmissions.
- Do not block air intakes and outlets on the indoor or outdoor units.

Energy Saving Recommendations

The following recommendations will add greater efficiency to the ductless system:

- Select a comfortable thermostat setting and leave it at chosen setting. Avoid raising and lowering the setting.
- depending on indoor air quality.

Keep the filter clean. Frequent cleaning may be necessary

Use drapes, curtains, or shades to keep direct sunlight from heating the room on very hot days.

- Limit the unit's run time by using the **TIMER** function.
- Do not obstruct the air intake on the front panel.
- Turn on the air conditioning unit before the indoor air becomes too uncomfortable.

TROUBLESHOOTING

Refer to Table 2 before contacting your local dealer.

Table 2—Periodic Maintenance

INDOOR UNIT	EVERY MONTH	EVERY 6 MONTHS	EVERY YEAR
Clean Air Filter*	•		
Change Remote Control Batteries			•
OUTDOOR UNIT	EVERY MONTH	EVERY 6 MONTHS	EVERY YEAR
Clean Outdoor Coil from Outside			
Clean Outdoor Coil from Inside†			•
Blow Air Over Electric Parts†			•
Check Electric Connection Tightening† Clean			•
Fan Wheel†			•
Check Fan Tightening†			•
Clean Drain Pans†			•

Increase frequency in dusty zones.

CAUTION

If one of the following conditions occurs, switch off the power supply immediately and contact your dealer for further assistance.

- The operation light continues to flash rapidly after the unit has been restarted.
- The remote control buttons do not work.
- The unit continually trips fuses or circuit breakers.
- A foreign object or water enters the air conditioner.
- Other abnormal situations.

The following symptoms are not malfunctions and in most situations will not require repairs.

Maintenance to be carried out by qualified service personnel. Refer to the Installation Manual.

Table 3—Common Problems

PROBLEM	POSSIBLE CAUSES	
Unit does not turn on when pressing ON/ OFF	The unit has a 3—minute protection feature that prevents the unit from overloading. The unit cannot be restarted within three minutes of being turned off.	
	Cooling and Heating Models: If the Operation light and PRE—DEF (Pre—heating/ Defrost) indicators are lit up, the outdoor temperature is too cold and the unit's anti—cold wind is activated in order to defrost the unit.	
	In Cooling—only Models: If the "Fan Only" indicator is lit up, the outdoor temperature is too cold and the unit's anti—freeze protection is activated in order to defrost the unit.	
The unit changes from COOL mode to FAN mode	The unit changes its setting to prevent frost from forming on the unit. Once the temperature increases, the unit will start operating again.	
	The set temperature has been reached, at which point the unit turns off the compressor. The unit will resume operating when the temperature fluctuates again.	
The indoor unit emits white mist	In humid regions, a large temperature difference between the room's air and the conditioned air can cause white mist.	
Both the indoor and outdoor units emit white mist	When the unit restarts in HEAT mode after defrosting, white mist may be emitted due to moisture generated from the defrosting process.	
The indoor unit makes noises	A squeaking sound is heard when the system is OFF or in COOL mode. The noise is also heard when the drain pump (optional) is in operation.	
	A squeaking sound may occur after running the unit in HEAT mode due to expansion and contraction of the unit's plastic parts.	
	A low hissing sound may occur during operation. This is normal and is caused by refrigerant gas flowing through both the indoor and outdoor units.	
Both the indoor unit and outdoor unit make noises	A low hissing sound may be heard when the system starts, has just stopped running or is defrosting. This noise is normal and is caused by the refrigerant gas stopping or changing direction.	
The outdoor unit makes noises	The unit will make different sounds based on its current operating mode.	
Dust is emitted from either the indoor or outdoor unit	The unit may accumulate dust during extended periods of non—use, which will be emitted when the unit is turned on. This can be mitigated by covering the unit during long periods of inactivity.	
The unit emits a bad odor	The unit may absorb odors from the environment (such as furniture, cooking, cigarettes, etc.) which will be emitted during operations.	
	The unit's filters have become moldy and should be cleaned.	
The fan of the outdoor unit does not operate	During operation, the fan speed is controlled to optimize product operation.	

Table 4—Troubleshooting Tips

PROBLEM	POSSIBLE CAUSE	SOLUTION
Unit/System Does Not Work	The circuit breaker has tripped or a fuse has blown. Power failure. Diagnostic lights illuminate.* Voltage is too low Remote control batteries are dead The unit's 3 minute protection has been activated.	Reset the circuit breaker or replace the fuse with the specified replacement fuse. Restart operation when the power is restored. Call your service representative. Call your service representative. Replace the remote control batteries Wait three minutes after restarting the unit.
Poor cooling performance	The filter is blocked with dust. Temperature is not set properly. A window or door is open. The outdoor unit is obstructed. The fan speed is too low. The operation mode is in Fan instead of Cool. Low refrigerant due to leak or long—term use of refrigerant.	Clean the air filter. Check the temperature and reset if necessary. Ensure all doors and windows are closed while operating the unit. Turn the unit off, remove the obstruction and turn it back on. Change the fan speed selection. Change the operating mode to Cool or reset the unit. Check for leaks, re—seal if necessary and top off refrigerant.
Poor heating performance	The filter is blocked with dust. Temperature is set too low. A window or door is open. The outdoor unit is obstructed.	 Clean the air filter. Check the temperature and reset if necessary. Ensure all doors and windows are closed while operating the unit. Turn the unit off, remove the obstruction and turn it back on.
Unit Stops During Operation	The Off timer is not operating correctly. Diagnostic lights illuminate.*	Restart the operating mode.Call your service representative.

^{*} Diagnostic lights are a combination of lights that will illuminate in the display area on the unit. They are a combination of the lights you see during normal operation.