50ES-A, 50EZ-A, 50VG-A, 50VL-A, B, C, 50VR-A, 50VT-A, B, C 604D-A, 607C-A, B, C, 607E-A, 704D-A, 707C-A, B, C, 707E-A PA3G-A, PH3G-A, PA4G, PH4G PAD3, PHD3, PAD4, PHD4, WPA4, WPH4, PAR5, PHR5

SMALL PACKAGED PRODUCTS Electric Heaters 5-20kW 60 Hz Product

Installation Instructions

NOTE: Read the entire instruction manual before starting the installation.

NOTE: Installation Instructions include Single and Dual point connection instructions separately.

SAFETY CONSIDERATIONS

Installation and servicing of this equipment can be hazardous due to mechanical and electrical components. Only trained and qualified personnel should install, repair, or service this equipment. Untrained personnel can perform basic maintenance functions such as cleaning and replacing air filters. All other operations must be performed by trained service personnel. When working on this equipment, observe precautions in the literature, on tags, and on labels attached to or shipped with the unit and other safety precautions that may apply.

Follow all safety codes. Installation must be in compliance with local and national building codes. Wear safety glasses, protective clothing, and work gloves. Have fire extinguisher available. Read these instructions thoroughly and follow all warnings or cautions included in literature and attached to the unit. Consult local building codes, the current editions of the National Electrical Code (NEC) NFPA 70.

In Canada refer to the current editions of the Canadian Electrical Code CSA C22.1.

Recognize safety information. This is the safety-alert symbol \triangle . When you see this symbol on the unit and in instructions or manuals, be alert to the potential for personal injury. Understand these signal words; DANGER, WARNING, and CAUTION. These words are used with the safety-alert symbol. DANGER identifies the most serious hazards which **will** result in severe personal injury or death. WARNING signifies hazards which **could** result in personal injury or death. CAUTION is used to identify unsafe practices which **may** result in minor personal injury or product and property damage. NOTE is used to highlight suggestions which **will** result in enhanced installation, reliability, or operation.

Follow all safety codes. Wear safety glasses and work gloves. Have a fire extinguisher available.

Before proceeding with heater installation, inspect thoroughly for shipping damage. Notify shipper immediately if any damage is found. Clean all dirt, dust and moisture from heater package. Check for proper clearances of live parts, between phases and to ground. Make sure that all required barriers are in place. Check conductors run in multiple to insure that they are properly wired. Refer to unit installation instructions for complete unit installation details. The maximum duct static for safe electric heater operation is shown in Table 1.

A WARNING

ELECTRICAL SHOCK HAZARD

Failure to follow this warning could result in personal injury or death.

Before performing installation, service or maintenance operations on this system, turn off all main power to system. There may be more than one disconnect switch. Turn off accessory heater power switch if applicable. Lockout and tag switch with a suitable warning label.

A CAUTION

CUT HAZARD

Failure to follow this caution may result in personal injury.

Sheet metal parts may have sharp edges or burrs. Use care and wear appropriate clothing, safety glasses and gloves when handling parts.

DESCRIPTION AND USAGE

This electric heater series is engineered, designed and listed to be installed only in the models shown in Table 2. Before proceeding, verify the heater label for correct voltage and kW requirements.

PACKAGE CONTENTS

Electric Heater Package Contents


- 1. Heater assembly
- 2. UPC heater label
- 3. Installation instructions
- 4. Identification label
- 5. Schematic on lid door for all fused units
- Schematic on sticker to be placed inside unit panel for non-fused units
- 7. Wire connectors (3)
- 8. Wire ties-6-in. (5)
- 9. Screws #10A (5)
- 10. Dual Point Warning Label
- 11. Dual Point Electrical Rating Label

INSTALLATION

SINGLE POINT HEATER INSTALLATION

NOTE: Thermostat used must be capable of energizing "G" (indoor fan) on a call for "W" (heating). If "G" is not energized system malfunction will occur.

- 1. Open all electrical disconnects and install lockout tag before beginning any installation or service work.
- 2. Check for proper equipment model number from list.
- Verify that unit ductwork is installed per base unit instructions.
- 4. Remove unit electrical access panel (See Fig. 1).
- Locate and remove the heater access cover plate inside unit access panel (See Fig. 3). Save screws.
- 6. Remove electric heater from the packaging.
- Install heater, sliding assembly carefully through access hole. Ensure that mounting holes of heater align with mounting holes on the unit. Secure heater assembly with screws provided.
- 8. Attach provided heater wiring labels at appropriate locations (see Fig. 11 or Fig. 12).
- 9. Dress wires with wire ties provided.



A1319

Fig. 1 - Unit Access Panel and Label Location

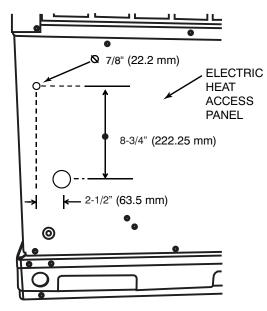


Fig. 2 - Second Power Line Access Hole Location

SINGLE POINT ELECTRICAL CONNECTION

NOTE: All electrical connections, wire sizes and type of conduit shall meet the National Electric Code (NEC) and state and local codes (or International Electric Code) as applicable.

NOTE: Use minimum 75°C copper wire only.

- Make sure all disconnects are still open and tagged out as required previously.
- 2. Mark the main unit nameplate with an "X" for the electric heater size being installed. Refer to the electrical data marked with an "X" on the nameplate for wire and maximum over current protection sizing.

NOTE: On some outdoor models the accessory electric heater kit numbers have changed. Before installing heater kit, make sure kit is approved by referring to unit rating plate, and if used, unit label showing cross reference of approved heaters. Only use kits listed on unit rating plate or approved alternate.

 Connect low voltage wires as shown in unit schematic diagrams found on the base unit installation instructions.
 These connections must be made in the 24v barrier section inside the unit panel (See Fig. 3).

NOTE: If the unit 24V wires do not have a matching receptacle, cut the 24V wires from the electric heater plug, strip the ends, and wire nut together to match the schematic connections. If the electric heater 24V wires do not have a matching plug, cut the 24V wires from the unit receptacle, strip the ends, and wire nut together to match the schematic connections.

4. Insert field power line through the electrical heater access panel hole (see Fig. 6 or 7) and connect to electric heater as shown in their respective wiring diagram. Fused electrical heaters field lines will be connected to the fuse block lugs (see Fig. 10) and non fused electric heater field lines will be connected to heater leads using wire nuts. Ground electrical equipment in the appropriate locations. Seal all openings to prevent air leaks.

IMPORTANT: Heaters with factory installed fuses may be installed on a branch circuit protected by either a fuse or circuit breaker. For all other heaters, the branch circuit must be protected by a fuse or circuit breaker supplied by others.

Connect stripped wires from heater to compressor contactor leads using supplied wire nuts according to their heater wiring diagram.

NOTE: Dress wires with wire ties provided. For fused heaters, use pre-mounted wire tires inside of fuse box cover to secure and strain relieve wires.

- 6. Separate all wires from incoming power leads.
- 7. Close electrical access panel.

DUAL POINT HEATER INSTALLATION

NOTE: Complete single point heater installation procedures before completing the follow steps.

- Open all electrical disconnects and install lockout tag before beginning any installation or service work.
- 2. Remove electric access panel (see Fig. 1), check to make sure there is clearance on the inside of control box above the existing high voltage knockout. Using a knockout punch and die combination, make a 7/8-in. hole on the Electrical Heat access panel for second power circuit (see Fig. 2). A knockout punch and die combination or equivalent tool is required to make this hole. Other types of drill bits or standard hole saws are not acceptable.
- 3. Attach warning and rating labels in the selected location (see Fig. 1).

- 4. Mark the main unit nameplate with an "X" next to the accessory heater "none". Mark the dual point rating label installed at step 3 with an "X" for the electrical heater size being installed. Refer to the electrical data marked with an "X" on each nameplate for wire and maximum over current protection sizing.
- Remove power line connection from heater to unit contactor and compressor (see Fig. 4 and Fig. 5). These are the stripped end wires black and yellow, with opened ends.

DUAL POINT ELECTRICAL CONNECTION

NOTE: All electrical connections, wire sizes and type of conduit shall meet the national Electric Code (NEC) and state and local codes (or International Electric Code) as applicable.

NOTE: Use a minimum 75°C copper wire only.

- Make sure all disconnects are still open and tagged out as required previously.
- 2. Connect low voltage wires as shown in unit schematic diagrams found on base unit installation instructions. These connections must be made in the 24v barrier section inside the unit panel (see Fig. 3).

NOTE: If the unit 24V wires do not have a matching receptacle, cut the 24V wires from the electric heater plug, strip the ends, and wire nut together to match the schematic connections. If the electric heater 24V wires do not have a matching plug, cut the 24V wires from the unit receptacle, strip the ends, and wire nut together to match the schematic connections.

3. Insert first field power line through the electrical heater access panel bottom hole (see Fig. 8 or Fig. 9) and connect to electric heater as shown in their respective wiring diagram found on the heater accessory kit. Fused electrical heaters field lines will be connected to the fuse block lugs (see Fig. 10.) and non fused electric heater field lines will be connected to heater leads using wire nuts. Ground electrical equipment in the appropriate locations. Seal all openings to prevent air leaks.

IMPORTANT: Heaters with factory installed fuses may be installed on a a branch circuit protected by either a fuse or circuit breaker. For all other heaters, the branch circuit must be protected by a fuse or circuit breaker supplied by others.

NOTE: Dress wires with wire ties provided. For fused heaters, use pre-mounted wire ties inside of fuse box cover to secure and strain relieve wires.

- 4. Insert second field power line through the electrical heater access panel top hole (see Fig. 8 or Fig. 9) and connect to unit contactor black and yellow leads using wire nuts. Ground electrical equipment in the appropriate locations.
- 5. Separate all wires from incoming power leads.
- 6. Close electrical access panel.

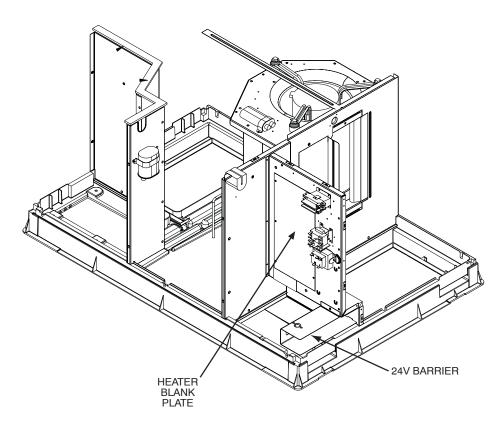


Fig. 3 - Heater Blank Plate Location

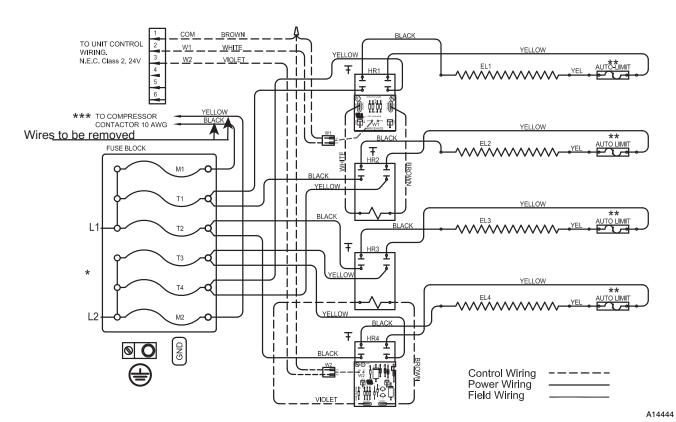


Fig. 4 - Wiring Diagram Example for Fused Heater

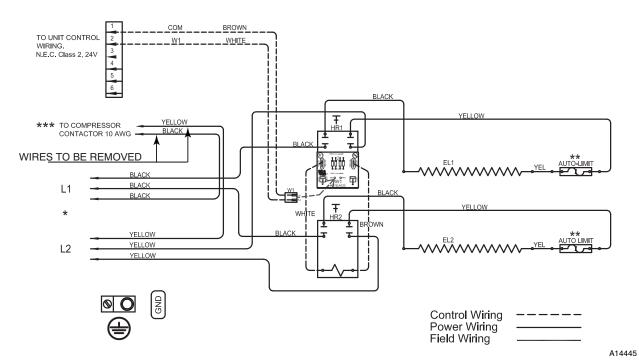


Fig. 5 - Wiring Diagram Example for Non-Fused Heater

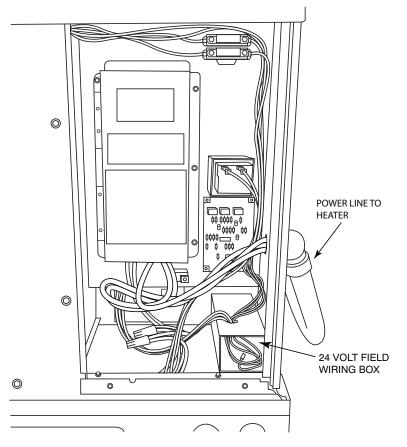


Fig. 6 - Single Point Connections for Fused Heater

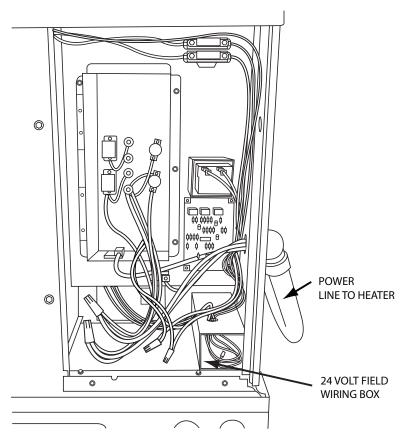


Fig. 7 - Single Point Connections for Non-Fused Heater

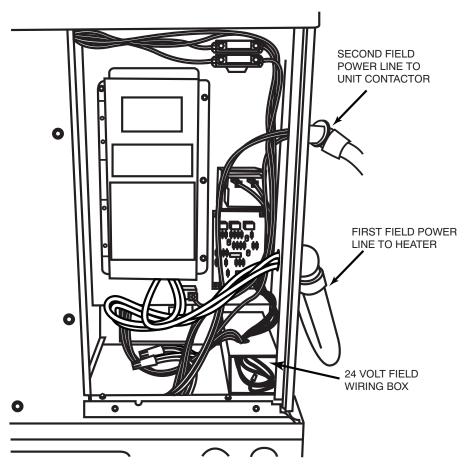


Fig. 8 - Dual Point Connections for Fused Heater

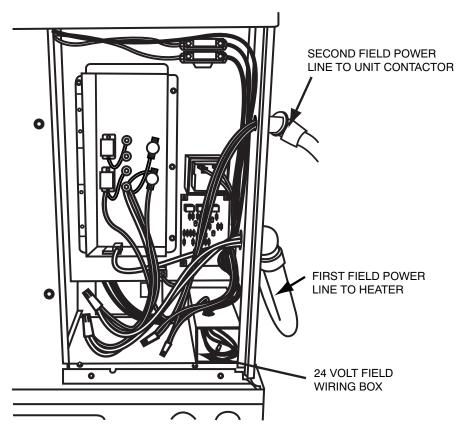


Fig. 9 - Dual Point Connection for Non-Fused Heater

A10340

START-UP

A WARNING

ELECTRICAL SHOCK HAZARD

Failure to follow this warning could result in personal injury or death.

Before proceeding, verify that all wiring is correct per factory approved schematic. Notify factory immediately of any discrepancies.

NOTE: Heater Relay, Rectifier, Time Delay Boards

208/230 1 PH and 3 PH heaters only (does not include 460v). Each heater element is controlled by a 24VDC control relay. Each control relay is energized by a small rectifier board attached directly to relay coil terminals. When possible one rectifier board is used to control a second relay.

The rectifier board converts incoming 24v AC control signal to DC. Some heaters may have up to four relays. The second and/or third relay rectifier board may also have a time delay feature and a small jumper wire built into it. With the jumper uncut, the time delay is approximately 5 sec after the initial first stage. When jumper is cut at factory this provides an 8 sec delay.

NOTE: Refer to base unit installation instructions as required.

- 1. Check for loose terminal connections.
- Check that all fuse and circuit breaker short circuit interrupting ratings are adequate.

- 3. Turn on unit and heater power.
- 4. Set thermostat to call for heat.
- 5. Check operation of heater.
- 6. Check that airflow across the heater is at or above the minimum recommended CFM requirement (See unit installation instructions). Adjust indoor blower heat speed as required. Check that duct system conforms to static pressure limits in Table 1.

NOTE: See Table 1 for Non-Export units (with -3, -5 or -6 as electrical option-see product data).

TROUBLESHOOTING

- Fuses Malfunction will interrupt power to the unit. Check for cause of failure, replace fuses.
- Limit Switch Malfunction prevents heating element(s) from being energized. Replace switch if malfunction occurs.
- Contactor Malfunction will not allow heater to energize.
 Replace faulty contactor. Do not attempt to replace coil or dress contacts.

Table 1 – Maximum Duct Static Pressure for 60 Hz Units (IN. W.C.) (pa)

UNIT	MAXIMUM STATIC PRESSURE												
(60 HZ UNITS)	UNIT SIZE												
(60 HZ UNITS)	024	030	036	042	048	060							
Heat Pump	.30	.30	.30	.50	.50	.50							
	(75)	(75)	(75)	(125)	(125)	(125)							
Electric	.30	.30	.30	.50	.50	.50							
Cooling	(75)	(75)	(75)	(125)	(125)	(125)							

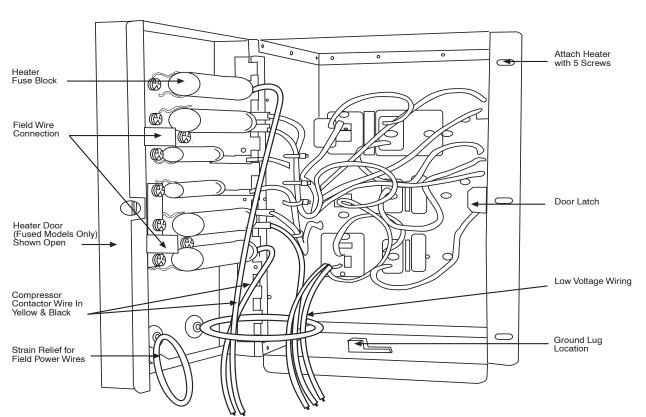


Fig. 10 - Fused Heater Control Box

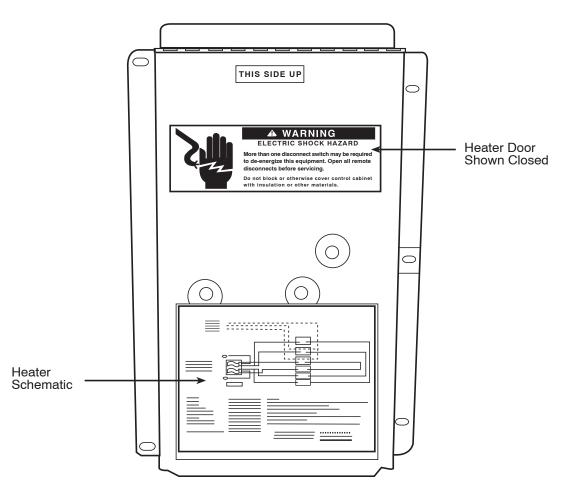


Fig. 11 - Schematic Location for Fused Heaters

C01042

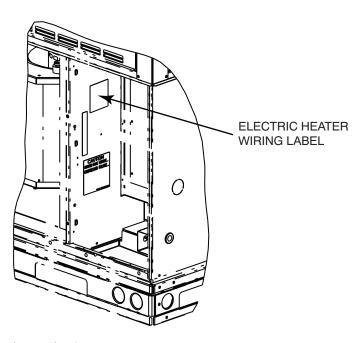


Fig. 12 - Schematic Location for Non-Fused Heater

Table 2 – Electric Heater Usage Chart—60 Hz Units

				Table 2			-A, 704				50VL-A, B, C, 707CA, B, C, PA4G, PAD4, WPA4 (PAC)							
CPHEATER	Code	kW	V	PH	Fuse	24	30	36	42	48	60	24	30	36	42	48	60	
052	UL	5	230	1	0	х	Х	х	х	х	Х	Х	Х	х	Х	Х	х	
064	UL	5	230	1	4	х	Х	х	х	х	х	Х	Х	х	х	х	х	
069	UL	7.2	230	1	0	Х	Х	х	х	х	х	Х	х	х	х	х	х	
070	UL	7.2	230	1	4	Х	Х	х	х	х	х	х	Х	х	х	х	х	
065	UL	10	230	1	0	Х	Х	х	х			Х	Х	х	х			
050	UL	10	230	1	4	х	Х	х	х	х	х	Х	х	х	х	х	х	
051	UL	15	230	1	4		Х	х	х				Х	х	х			
066	UL	15	230	1	6		Х	х	х	х	Х		х	х	х	х	х	
053	UL	20	230	1	4				х						х			
054	UL	20	230	1	6				х	х	Х				х	х	х	
055	UL	5	230	3	0		Х	Х	Х	Х	Х			Х	Х	Х	Х	
056	UL	10	230	3	0		Х	х	х	х	Х			Х	Х	Х	х	
068	UL	10	230	3	6		х	х	х	х	х			х	х	Х	х	
057	UL	15	230	3	0		х	х	х	х	х			х	х	х	х	
058	UL	15	230	3	6		х	х	х	х	х			х	х	х	х	
059	UL	20	230	3	6				х	х	х					х	х	
061	UL	10	460	3	0			х	х	х	Х			х	х	х	х	
062	UL	15	460	3	0			х	х	х	х			х	х	х	х	
063	UL	20	460	3	0				х	х	х				х	х	х	

= base unit not offered

x = Approved combination

·							50V	G-A, 707E-	-A, PAR5 ((PAC)	
CPHEATER	Code	kW	V	PH	Fuse	24	30	36	42	48	60
052	UL	5	230	1	0	х	х	х	х	х	х
064	UL	5	230	1	4	х	х	х	х	х	х
069	UL	7.2	230	1	0	х	х	х	х	х	х
070	UL	7.2	230	1	4	х	х	х	х	х	х
065	UL	10	230	1	0	х	х	х	х		
050	UL	10	230	1	4	х	х	х	х	х	х
051	UL	15	230	1	4		х	х	х		
066	UL	15	230	1	6		х	х	х	х	х
053	UL	20	230	1	4				х		
054	UL	20	230	1	6				x	х	х
055	UL	5	230	3	0		х	Х	х	Х	Х
056	UL	10	230	3	0		х	х	х	х	х
068	UL	10	230	3	6		х	х	х	х	х
057	UL	15	230	3	0		х	х	х	х	х
058	UL	15	230	3	6		х	х	х	х	х
059	UL	20	230	3	6				х	х	х
061	UL	10	460	3	0			х	Х	х	х
062	UL	15	460	3	0			х	х	х	х
063	UL	20	460	3	0				х	х	х

= base unit not offered

x = Approved combination

Table 2 — Electric Heater Usage Chart—60 Hz Units Continued

						50EZ	-A, 604I	DA, P	H3G	A, PHD3	(PHP)	50VT-A, B, C, 607CA, B, C, PH4G, PHD4 WPH4 (PHP)							
CPHEATER	Code	kW	V	PH	Fuse	24	30	36	42	48	60	24	30	36	42	48	60		
052	UL	5	230	1	0	Х	х	Х				Х	Х	Х	Х				
064	UL	5	230	1	4	х	х	х	х	Х	х	Х	Х	х	х	х	х		
069	UL	7.2	230	1	0							Х							
070	UL	7.2	230	1	4	Х	х	Х	х	х	Х	Х	Х	х	х	х	х		
065	UL	10	230	1	0														
050	UL	10	230	1	4	Х	х	Х	Х	Х	Х	Х	Х	х	х	Х	х		
051	UL	15	230	1	4														
066	UL	15	230	1	6		х	х	Х	Х	х		Х	х	х	Х	х		
053	UL	20	230	1	4														
054	UL	20	230	1	6				х	х	Х				х	х	х		
055	UL	5	230	3	0		Х	Х	Х	Х	Х			Х	Х	Х	Х		
056	UL	10	230	3	0		х	х	Х	Х				Х	х				
068	UL	10	230	3	6		х	х	х	х	х			х	х	х	х		
057	UL	15	230	3	0														
058	UL	15	230	3	6		х	х	Х	Х	х			Х	х	х	х		
059	UL	20	230	3	6				х	х	х				х	х	х		
061	UL	10	460	3	0			х	Х	Х	X			Х	Х	Х	X		
062	UL	15	460	3	0			х	х	х	X			х	х	х	х		
063	UL	20	460	3	0				х	х	x				х	х	х		

⁼ base unit not offered

x = Approved combination

							50VI	R-A, 607E-	-A, PHR5 (PHP)	
CPHEATER	Code	kW	V	PH	Fuse	24	30	36	42	48	60
052	UL	5	230	1	0	х	х	х			
064	UL	5	230	1	4	х	х	х	х	х	х
069	UL	7.2	230	1	0	х					
070	UL	7.2	230	1	4	х	х	х	х	х	х
050	UL	10	230	1	4	х	х	х	х	х	х
066	UL	15	230	1	6		х	х	х	х	х
054	UL	20	230	1	6				х	х	х
055	UL	5	230	3	0		х	х	х	х	х
056	UL	10	230	3	0		х	х	х	х	
068	UL	10	230	3	6		х	х	х	Х	х
058	UL	15	230	3	6		х	х	х	х	х
059	UL	20	230	3	6				х	х	х
061	UL	10	460	3	0			X	х	х	Х
062	UL	15	460	3	0			х	х	х	Х
063	UL	20	460	3	0				х	х	Х

⁼ base unit not offered

x = Approved combination

Table 3 - Electric Heater Part Number Information

Г			_																		_	
	KW Staging	Stage-2	:	10kw		10kw	10kw			10kw								:			:	
	KW Si	Stage-1	10kw	5kw	5kw	10kw	10kw	5kw	10kw	5kw	7.2kw	7.2kw	5kw	10kw	15kw	15kw	20kw	10kw	10kw	15kw	20kw	
	Viring	W2 (Violet)	1	×	-	×	×	-	-	×	-	-	-	-	-	-	1	ı	-		ı	
	24v Unit Control Wiring	W1 (White)	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	
	24v Uni	Comm (Brown)	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	×	
	Š	Stages	- 2 - 2 2											1	1	1	1	-	1	1	-	
Пастоп	Power Connection	Fuse Block	×	×	1	×	×	×	1	×	-	×	:	1	1	×	×	×	1	-	:	
TOTAL	Conr	Pig Tail	1	ı	×		-		×		×		×	×	×			-	×	×	×	
le 3 – Electric Licater Fart Indiliber Illiorillation		480v					,	-			-			•	-				12	18	24.1	
ותו ומו	Amps	240v	41.7	62.5	20.8	83.3	83.3	20.8	41.7	62.5	30	30	12	24.1	36.1	36.1	47.9	24.1	-	-		
		208v	36.1	54.2	18.1	72.2	72.2	18.1	36.1	54.2	25.9	25.9	10.4	20.8	31.3	31.3	41.4	20.8	-	-		
1		Hz	8																			
Ianico	V / PH / Hz	Phase		-											ю							
	^	>	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	208/230	460	460	460	
		480									-			-					10	15	20	
	KW @	240	10	15	2	20	20	2	10	15	7.2	7.2	2	10	15	15	19.9	10	-	-		
		208	7.5	11.3	3.8	15	15	3.8	7.5	11.3	5.4	5.4	3.8	7.5	11.3	11.3	14.9	7.5	-	-		
	Diagram – 111002737 111002732 111002740 111002741 111002741 111002733 111002733 111002739									111002734	111002735	111002742	111002743	111002745	111002746	111002747	111002744	111002755	111002756	111002757		
_	,	CPHEALER	050A02	051A02	052A02	053A02	054A02	064A02	065A02	066A02	069A02	070A02	055A02	056A02	057A02	058A02	059A02	068A02	061A02	062A02	063A02	

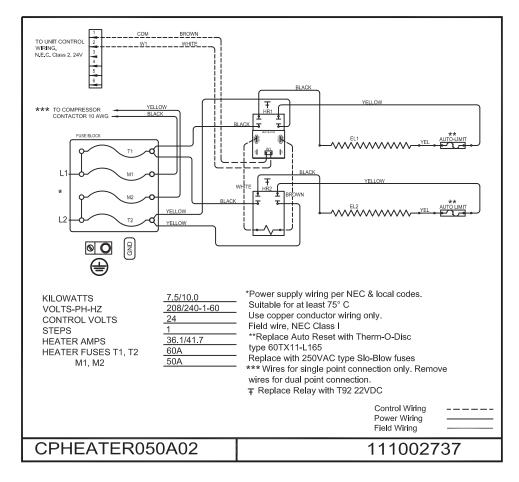


Fig. 13 - CPHEATER050A02 Wiring Diagram

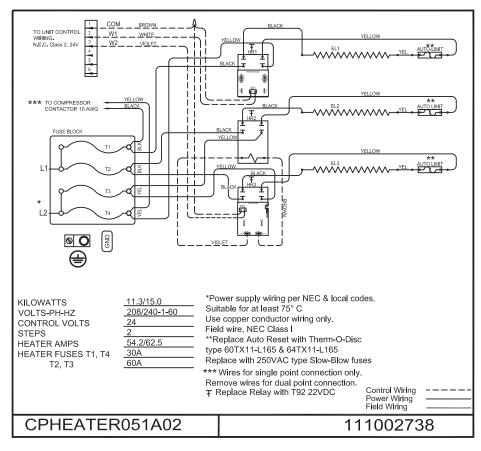


Fig. 14 - CPHEATER051A02 Wiring Diagram

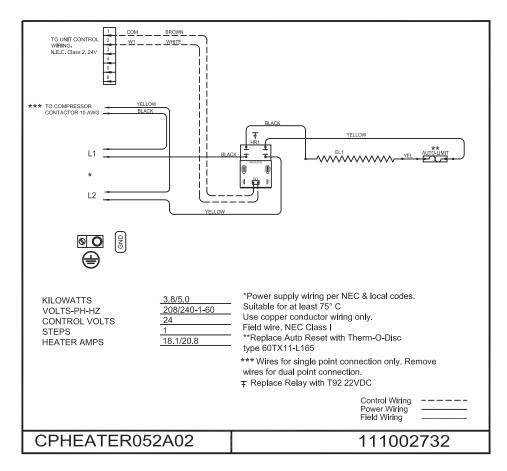


Fig. 15 - CPHEATER052A02 Wiring Diagram

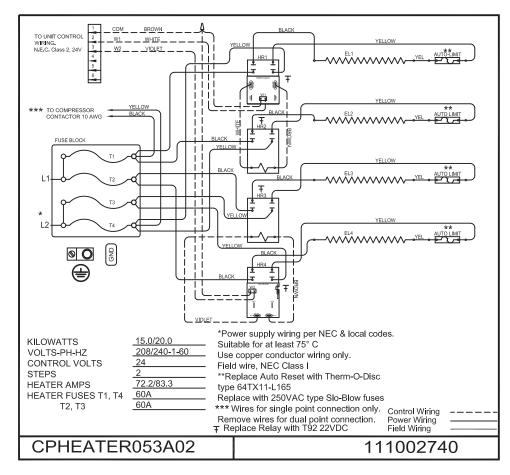


Fig. 16 - CPHEATER053A02 Wiring Diagram

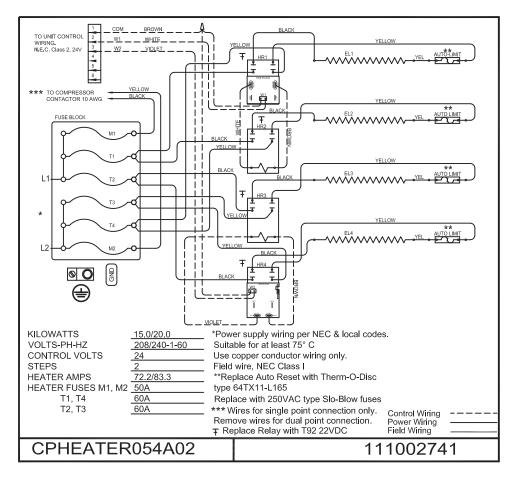


Fig. 17 - CPHEATER054A02 Wiring Diagram

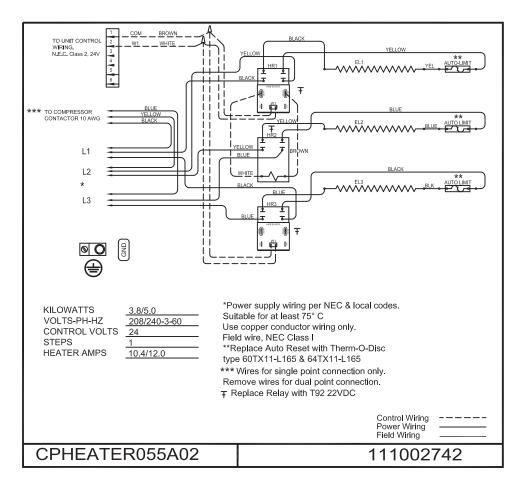


Fig. 18 - CPHEATER055A02 Wiring Diagram

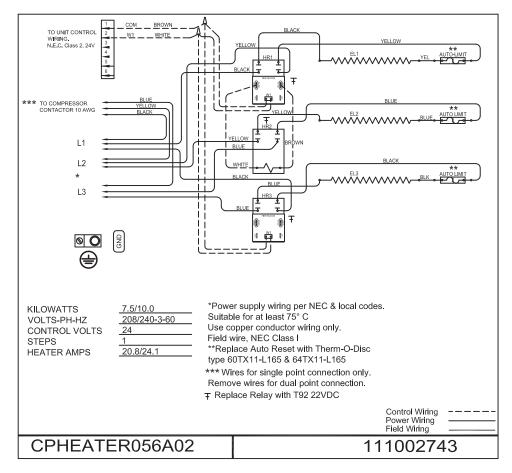


Fig. 19 - CPHEATER056A02 Wiring Diagram

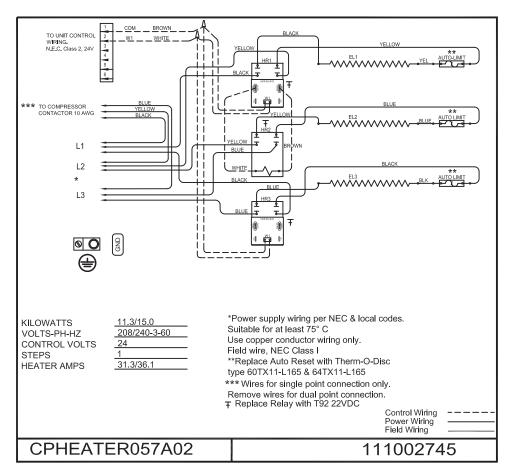


Fig. 20 - CPHEATER057A02 Wiring Diagram

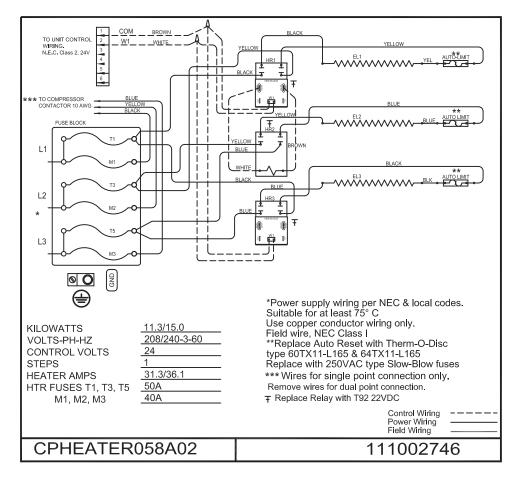


Fig. 21 - CPHEATER058A02 Wiring Diagram

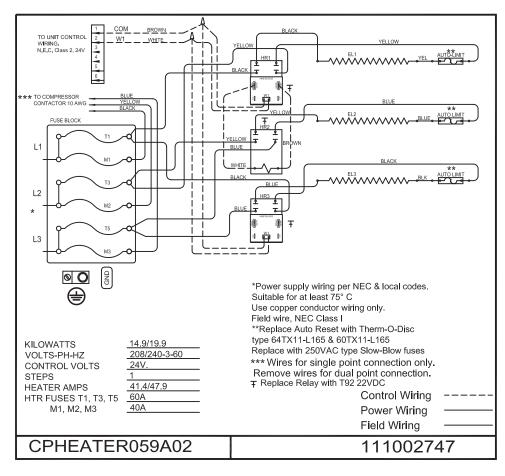


Fig. 22 - CPHEATER059A02 Wiring Diagram

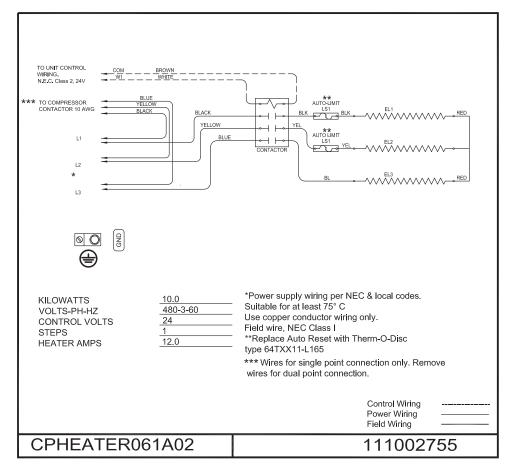


Fig. 23 - CPHEATER061A02 Wiring Diagram

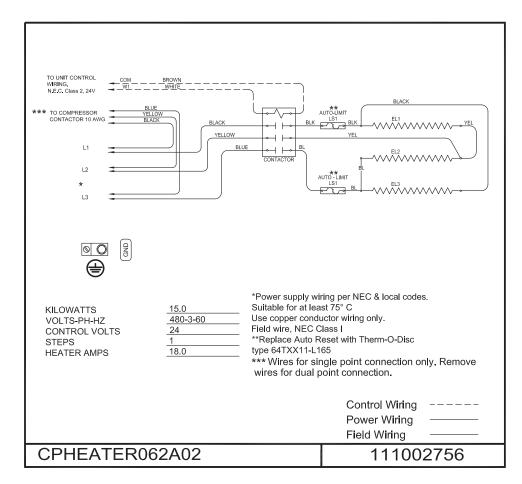


Fig. 24 - CPHEATER062A02 Wiring Diagram

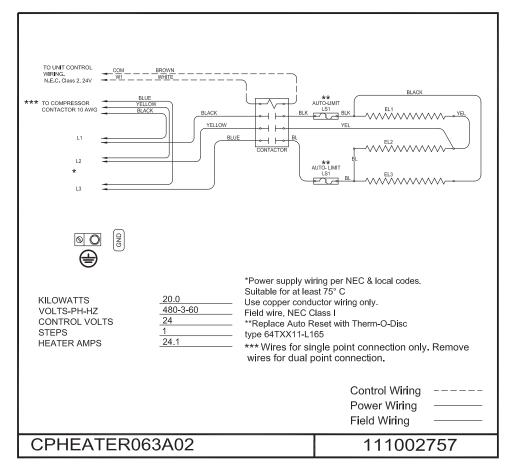


Fig. 25 - CPHEATER063A02 Wiring Diagram

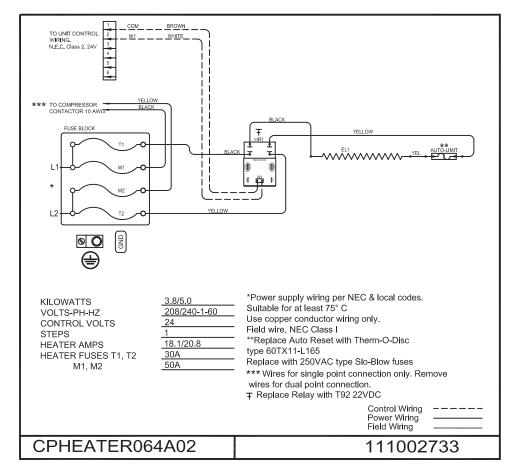


Fig. 26 - CPHEATER064A02 Wiring Diagram

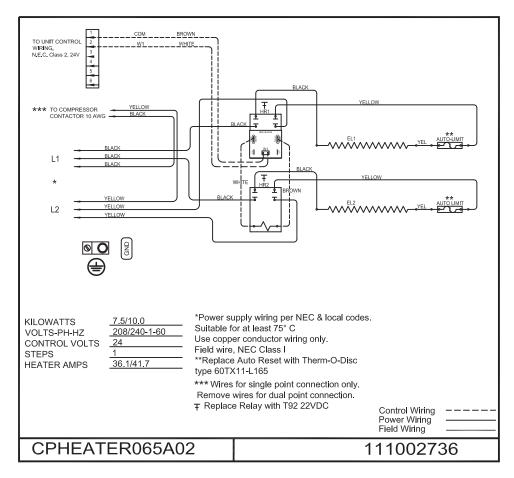


Fig. 27 - CPHEATER065A02 Wiring Diagram

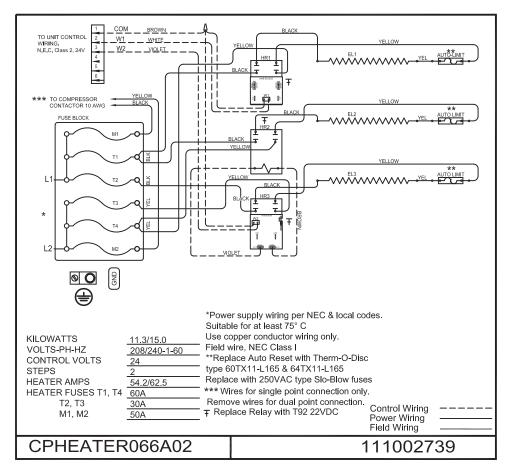


Fig. 28 - CPHEATER066A02 Wiring Diagram

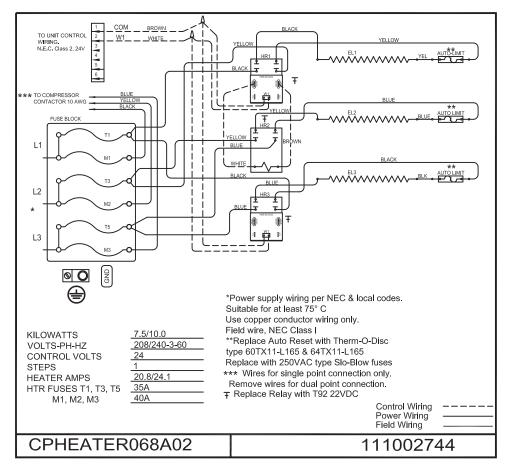


Fig. 29 - CPHEATER068A02 Wiring Diagram

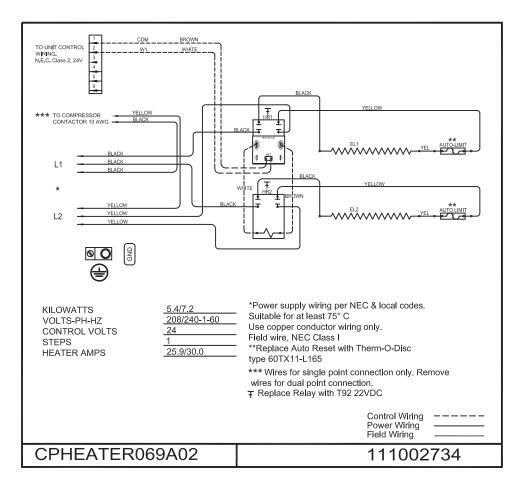


Fig. 30 - CPHEATER069A02 Wiring Diagram

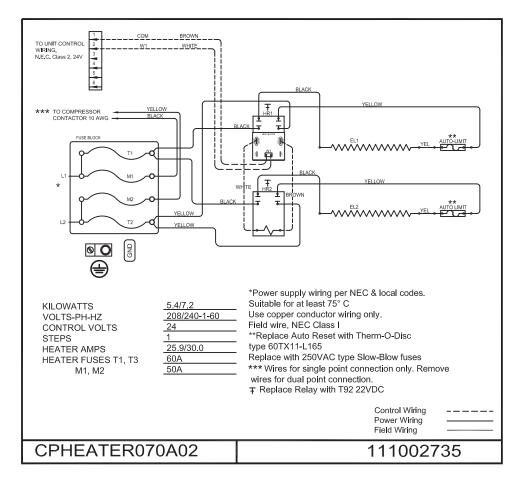


Fig. 31 - CPHEATER070A02 Wiring Diagram