

TECHNICAL SUPPORT MANUAL

Split System Heat Pump

(C,H,T)4H3

Safety Labeling and Signal Words

DANGER, WARNING, CAUTION, and NOTE

The signal words **DANGER**, **WARNING**, **CAUTION**, and **NOTE** are used to identify levels of hazard seriousness. The signal word **DANGER** is only used on product labels to signify an immediate hazard. The signal words **WARNING**, **CAUTION**, and **NOTE** will be used on product labels and throughout this manual and other manuals that may apply to the product.

DANGER – Immediate hazards which **will** result in severe personal injury or death.

WARNING – Hazards or unsafe practices which **could** result in severe personal injury or death.

CAUTION – Hazards or unsafe practices which **may** result in minor personal injury or product or property damage.

NOTE – Used to highlight suggestions which **will** result in enhanced installation, reliability, or operation.

Signal Words in Manuals

The signal word **WARNING** is used throughout this manual in the following manner:

 **WARNING**

The signal word **CAUTION** is used throughout this manual in the following manner:

 **CAUTION**

Signal Words on Product Labeling

Signal words are used in combination with colors and/or pictures on product labels.

TABLE OF CONTENTS

Model Number Identification	2
Wiring Diagrams	3
Charging Chart	4
Tech Labels (Expanded Data)	5 – 12
Cooling Multiplying Factors	13 – 17
Heating Multiplying Factors	18 – 22

MODELS

C4H318GKD200	H4H318GKD200	T4H318GKD200
C4H324GKD200	H4H324GKD200	T4H324GKD200
C4H330GKE100	H4H330GKE100	T4H330GKE100
C4H336GKE100	H4H336GKE100	T4H336GKE100
C4H342GKE100	H4H342GKE100	T4H342GKE100
C4H348GKE100	H4H348GKE100	T4H348GKE100
C4H360GKD300	H4H360GKD300	T4H360GKD300

 **WARNING**

DEATH, PERSONAL INJURY, AND/OR PROPERTY DAMAGE HAZARD

Failure to carefully read and follow this warning could result in equipment malfunction, property damage, personal injury and/or death.

Installation or repairs made by unqualified persons could result in equipment malfunction, property damage, personal injury and/or death.

The information contained in this manual is intended for use by a qualified service technician familiar with safety procedures and equipped with the proper tools and test instruments.


Installation must conform with local building codes and with the National Electrical Code NFPA70 current edition or Canadian Electrical Code Part 1 CSA C.22.1.

OUTDOOR UNIT MODEL NUMBER IDENTIFICATION GUIDE (single phase)

Digit Position:	1	2	3	4	5, 6	7	8	9	10	11	12
Example Part Number:	H	4	H	3	18	G	K	D	2	0	0
Product Family	REFRIGERANT		TYPE								
4 = R-410A											
A = Air Conditioner											
H = Heat Pump											
3 = 13 SEER											
4 = 14 SEER											
5 = 15 SEER											
6 = 16 SEER											
7 = 17 SEER											
8 = 18 SEER											
18 = 18,000 BTUH = 1½ tons											
24 = 24,000 BTUH = 2 tons											
30 = 30,000 BTUH = 2½ tons											
36 = 36,000 BTUH = 3 tons											
42 = 42,000 BTUH = 3½ tons											
48 = 48,000 BTUH = 4 tons											
60 = 60,000 BTUH = 5 tons											
A = Standard Grille											
G = Coil Guard Grille											
C = Coastal											
K = 208/230-1-60											
Sales Code											
Engineering Revision											
Extra Digit											
Extra Digit											
Extra Digit											

ACCESSORIES PART NUMBER IDENTIFICATION GUIDE

Digit Position:	1	2	3	4	5	6, 7	8, 9	10, 11
Example Part Number:	N	A	S	A	0	01	01	CH
N = Non-Branded	BRANDING							
A = Accessory								
S = Split System (AC & HP)								
A = Original								
B = 2nd Generation								
0 = Generic or Not Applicable								
2 = R-22								
4 = R-410A								
Product Identifier Number								
Package Quantity								
Type of Kit (Example: CH = Crankcase Heater)								

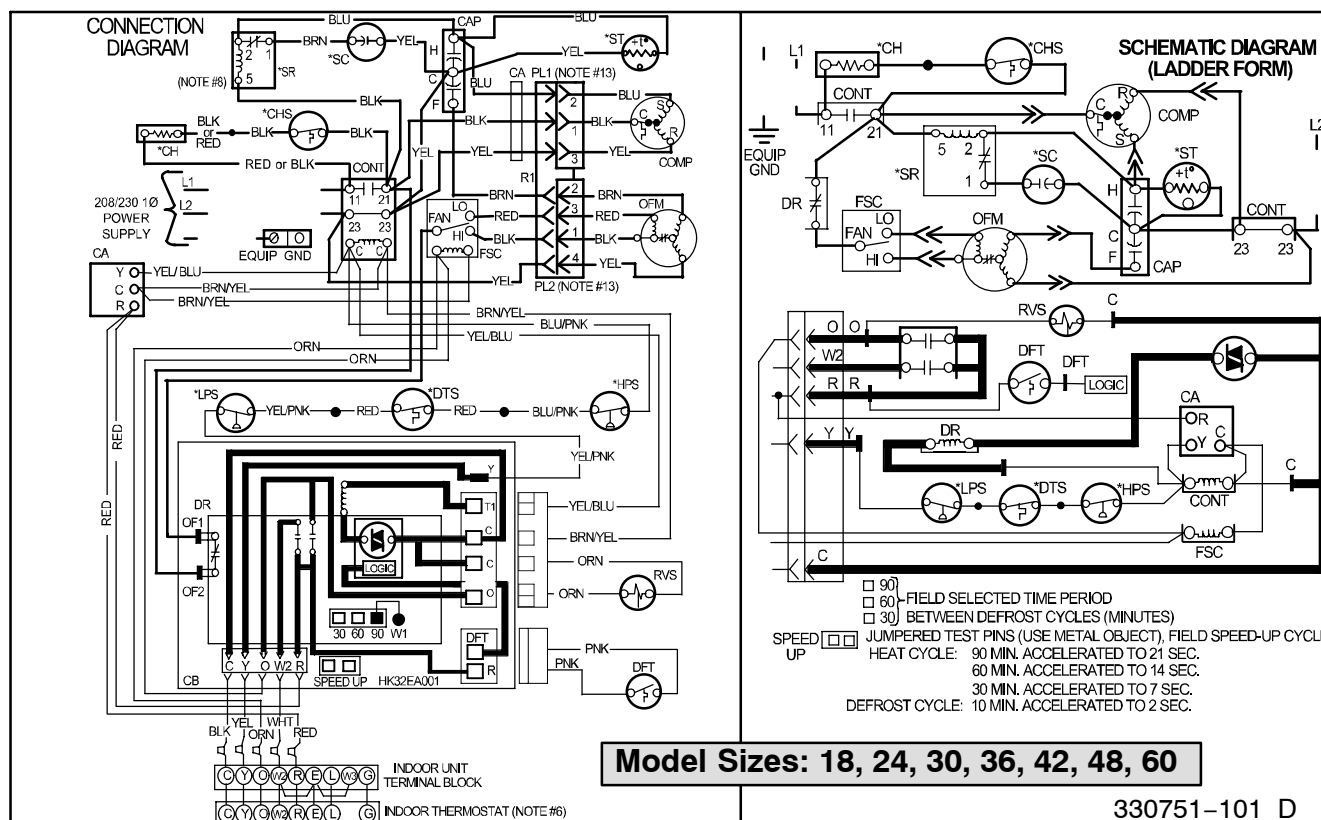

NOTES:

1. Symbols are electrical representation only.
2. Compressor and fan motor furnished with inherent thermal protection.
3. To be wired in accordance with National Electric N.E.C. and local codes.
4. N.E.C. class 2, 24 V circuit, min. 40 VA required, 60 VA on units installed with LLS.
5. Use copper conductors only. Use conductors suitable for at least 75°C (167°F).
6. Must use thermostat and sub-base as stated in pre-sale literature.
7. If indoor section has a transformer with a grounded secondary, connect the grounded side to the BRN/YEL lead.
8. When start relay and start capacitor are installed, start thermistor is not used.
9. If any of the original wire, as supplied, must be replaced, use the same or equivalent wire.
10. Check all electrical connections inside control box for tightness.
11. Do not attempt to operate unit until service valves have been opened.
12. Do not rapid cycle compressor. Compressor must be off 3 minutes to allow pressures to equalize between high and low side before starting.
13. Not for interrupting current.

R-410A CHARGING CHART												
Measured Liquid Pressure (psig)	Rating Plate (required) Subcooling Temperature °F (°C)											
	°F 6	(°C) 3	°F 8	(°C) 4	°F 10	(°C) 6	°F 12	(°C) 7	F 14	(°C) 8	F 16	(°C) 9
	R-410A Required Liquid Line Temperature °F (°C)											
251	78	26	76	24	74	23	72	22	70	21	68	20
259	80	27	78	26	76	24	74	23	72	22	70	21
266	82	28	80	27	78	26	76	24	74	23	72	22
274	84	29	82	28	80	27	78	26	76	24	74	23
283	86	30	84	29	82	28	80	27	78	26	76	24
291	88	31	86	30	84	29	82	28	80	27	78	26
299	90	32	88	31	86	30	84	29	82	28	80	27
308	92	33	90	32	88	31	86	30	84	29	82	28
317	94	34	92	33	90	32	88	31	86	30	84	29
326	96	36	94	34	92	33	90	32	88	31	86	30
335	98	37	96	36	94	34	92	33	90	32	88	31
345	100	38	98	37	96	36	94	34	92	33	90	32
364	104	40	102	39	100	38	98	37	96	36	94	34
374	106	41	104	40	102	39	100	38	98	37	96	36
384	108	42	106	41	104	40	102	39	100	38	98	37
395	110	43	108	42	106	41	104	40	102	39	100	38
406	112	44	110	43	108	42	106	41	104	40	102	39
416	114	46	112	44	110	43	108	42	106	41	104	40
427	116	47	114	46	112	44	110	43	108	42	106	41
439	118	48	116	47	114	46	112	44	110	43	108	42
450	120	49	118	48	116	47	114	46	112	44	110	43
462	122	50	120	49	118	48	116	47	114	46	112	44
474	124	51	122	50	120	49	118	48	116	47	114	46

MULTIPLYING FACTORS

(Refer to pages 5–11)

- † Total capacities are net (I.D. blower heat subtracted) system capacities based on 25 foot (7.6m) line set.
If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.
- †† At TVA rating indoor condition (75 °F db, 63 °F wb), all other indoor air temperatures are at 80 °F db
If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.
- * System amps are total of indoor and outdoor amps.
- ‡ Chart data is for 80° F indoor dry bulb. For indoor db temperatures other than 80° F, measure Indoor db and Indoor CFM, and plug these into the formula below. Measure outdoor db and indoor wet bulb, apply these to the chart above, find MBh and S/T, and plug these into the formula below.
(Note: if indoor db is the only thing changing, total capacity, MBh, stays the same.)

$$\text{Sensible Capacity at Indoor db LOWER than } 80^{\circ}\text{F} = (\text{MBh} \times \text{S/T}) - \left(\frac{(80 - \text{Indoor db}) \times 835 \times \text{Indoor CFM}}{1000} \right)$$

$$\text{Sensible Capacity at Indoor db HIGHER than } 80^{\circ}\text{F} = (\text{MBh} \times \text{S/T}) + \left(\frac{(\text{Indoor db} - 80) \times 835 \times \text{Indoor CFM}}{1000} \right)$$

COOLING		18 Size Outdoor With FS(M,U)4X18 Indoor Cooling																								
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																								
		75					85					95					105					115				
		Entering Indoor Temperature – Degrees F, Wet Bulb																								
CFM		72	67	63††	62	57	72	67	63††	62	57	72	67	63††	62	57	72	67	63††	62	57	72	67	63††	62	57
525	MBh†	20.50	18.60	17.24	16.89	16.29	19.51	17.69	16.37	16.04	15.62	18.48	16.72	15.45	15.16	14.91	17.37	15.70	14.49	14.24	14.15	16.20	14.60	13.45	13.33	13.33
	S/T‡	0.51	0.70	0.73	0.92	1.00	0.52	0.71	0.74	0.94	1.00	0.53	0.73	0.76	0.97	1.00	0.54	0.75	0.78	0.99	1.00	0.55	0.78	0.81	1.00	1.00
	AMPS*	5.81	5.85	5.89	5.89	5.90	6.48	6.53	6.56	6.56	6.57	7.23	7.27	7.30	7.30	7.31	8.04	8.08	8.12	8.12	8.12	8.94	8.99	9.01	9.01	9.01
	HI PR	268	266	264	263	263	309	307	305	304	304	355	352	350	350	349	405	402	400	400	400	460	457	455	455	455
	LO PR	155	142	132	130	126	157	144	135	133	129	160	147	137	135	133	162	149	139	138	137	165	152	142	141	141
600	MBh†	20.89	18.96	17.57	17.25	16.95	19.86	18.00	16.67	16.39	16.24	18.78	17.00	15.72	15.49	15.48	17.64	15.94	14.72	14.68	14.68	16.42	14.80	13.65	13.81	13.81
	S/T‡	0.53	0.73	0.76	0.96	1.00	0.54	0.75	0.78	0.98	1.00	0.54	0.77	0.79	1.00	1.00	0.56	0.79	0.82	1.00	1.00	0.57	0.82	0.85	1.00	1.00
	AMPS*	5.93	5.98	6.01	6.02	6.02	6.61	6.65	6.68	6.68	6.69	7.35	7.39	7.42	7.43	7.43	8.17	8.21	8.24	8.24	8.24	9.07	9.11	9.14	9.14	9.14
	HI PR	268	266	264	264	264	310	307	305	305	305	355	353	351	350	350	405	403	401	401	401	460	458	456	456	456
	LO PR	158	145	136	134	132	161	147	138	136	135	163	150	140	138	138	165	152	142	142	142	168	154	144	146	146
675	MBh†	21.17	19.23	17.83	17.57	17.50	20.12	18.24	16.89	16.75	16.75	19.00	17.20	15.91	15.96	15.96	17.83	16.11	14.88	15.12	15.12	16.57	14.95	13.79	14.21	14.21
	S/T‡	0.54	0.76	0.79	1.00	1.00	0.55	0.78	0.81	1.00	1.00	0.56	0.80	0.83	1.00	1.00	0.57	0.83	0.86	1.00	1.00	0.59	0.86	0.89	1.00	1.00
	AMPS*	6.06	6.10	6.14	6.14	6.14	6.73	6.78	6.81	6.81	6.81	7.48	7.52	7.55	7.55	7.55	8.29	8.34	8.37	8.36	8.36	9.19	9.24	9.27	9.26	9.26
	HI PR	269	267	265	265	265	311	308	306	306	306	356	353	351	351	351	406	403	401	402	402	461	458	456	457	457
	LO PR	161	148	138	137	136	163	150	140	139	139	165	152	142	143	143	168	154	144	146	146	170	157	146	150	150

HEATING		18 Size Outdoor With FS(M,U)4X18 Indoor Heating																							
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																							
		-3			7			17			27			37			47			57			67		
		Entering Indoor Temperature – Degrees F, Dry Bulb																							
CFM		65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75
525	MBH†	6.61	6.29	5.96	8.47	8.18	7.87	10.49	10.20	9.91	12.71	12.39	12.10	15.25	14.87	14.53	18.01	17.64	17.27	21.07	20.64	20.23	23.90	23.62	23.30
	T/R	13.40	12.80	12.30	17.30	16.80	16.30	21.50	21.10	20.70	26.30	25.90	25.50	31.90	31.40	30.90	38.10	37.60	37.10	45.20	44.60	44.00	51.80	51.60	51.30
	AMPS*	5.30	5.50	5.70	5.53	5.75	5.98	5.76	6.00	6.26	6.02	6.28	6.55	6.35	6.62	6.91	6.75	7.04	7.34	7.23	7.54	7.86	7.60	7.96	8.32
	HI PR	231	246	263	246	262	280	263	281	299	284	302	321	311	329	348	342	362	382	380	400	421	411	435	459
	LO PR	40	41	41	52	52	53	65	66	66	80	81	81	97	98	98	116	117	117	137	137	138	155	157	159
600	MBH†	6.77	6.46	6.12	8.66	8.37	8.08	10.69	10.41	10.12	12.97	12.62	12.33	15.54	15.21	14.82	18.36	18.00	17.62	21.41	21.06	20.67	24.06	23.79	23.50
	T/R	12.00	11.50	11.00	15.40	15.00	14.60	19.10	18.80	18.40	23.40	23.00	22.60	28.30	27.90	27.40	33.70	33.40	32.90	39.80	39.40	39.00	45.10	45.00	44.80
	AMPS*	5.38	5.58	5.78	5.57	5.80	6.03	5.77	6.02	6.28	6.01	6.27	6.54	6.30	6.58	6.86	6.66	6.95	7.25	7.03	7.36	7.71	7.38	7.72	8.07
	HI PR	227	242	259	240	257	274	256	273	291	275	292	311	299	318	336	328	347	367	358	380	403	388	410	433
	LO PR	40	41	41	52	52	52	65	66	66	80	81	81	97	97	98	116	116	117	136	137	137	152	154	156
675	MBH†	6.92	6.61	6.27	8.84	8.53	8.22	10.87	10.59	10.30	13.19	12.86	12.54	15.80	15.46	15.08	18.65	18.28	17.90	21.54	21.29	20.94	24.09	23.87	23.61
	T/R	10.80	10.40	10.00	13.90	13.60	13.20	17.20	16.90	16.60	21.10	20.70	20.40	25.40	25.10	24.70	30.30	29.90	29.50	35.30	35.20	34.90	39.80	39.80	39.70
	AMPS*	5.46	5.66	5.86	5.64	5.87	6.10	5.82	6.06	6.32	6.03	6.29	6.55	6.30	6.57	6.84	6.63	6.91	7.21	6.93	7.25	7.58	7.25	7.58	7.92
	HI PR	224	239	256	236	252	270	250	267	285	268	285	304	290	309	327	317	336	356	343	365	386	370	392	415
	LO PR	40	40	41	52	52	52	65	65	66	80	81	81	97	97	98	115	116	116	134	135	137	150	152	154

COOLING		24 Size Outdoor With FS(M,U)4X24 Indoor Cooling																								
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																								
		75					85					95					105					115				
		Entering Indoor Temperature – Degrees F, Wet Bulb																								
CFM		72	67	63††	62	57	72	67	63††	62	57	72	67	63††	62	57	72	67	63††	62	57	72	67	63††	62	57
700	MBh†	26.97	24.65	22.94	22.50	21.73	25.72	23.49	21.84	21.42	20.87	24.41	22.26	20.68	20.30	19.96	23.03	20.97	19.46	19.14	19.00	21.54	19.59	18.16	17.96	17.96
	S/T†	0.51	0.70	0.72	0.91	1.00	0.52	0.71	0.74	0.93	1.00	0.52	0.72	0.75	0.95	1.00	0.53	0.74	0.77	0.98	1.00	0.54	0.77	0.79	1.00	1.00
	AMPS*	7.21	7.21	7.22	7.21	7.22	8.09	8.10	8.10	8.10	8.11	9.07	9.08	9.09	9.09	9.09	10.16	10.17	10.18	10.18	10.18	11.36	11.37	11.39	11.39	11.39
	HI PR	281	278	275	275	274	324	320	318	317	316	371	367	365	364	363	422	418	416	415	415	479	475	473	472	473
	LO PR	154	141	131	129	125	156	143	133	131	128	158	145	135	133	131	161	148	138	136	135	164	150	140	139	139
800	MBh†	27.42	25.09	23.37	22.96	22.57	26.13	23.88	22.22	21.86	21.66	24.76	22.60	21.02	20.72	20.70	24.27	21.27	19.76	19.67	19.67	21.80	19.84	18.41	18.57	18.57
	S/T†	0.53	0.73	0.75	0.95	1.00	0.53	0.74	0.77	0.97	1.00	0.54	0.76	0.79	1.00	1.00	0.55	0.78	0.81	1.00	1.00	0.57	0.81	0.83	1.00	1.00
	AMPS*	7.36	7.36	7.37	7.37	7.37	8.25	8.25	8.26	8.26	8.26	9.22	9.23	9.24	9.24	9.24	8.95	10.32	10.34	10.33	10.33	11.50	11.52	11.53	11.54	11.54
	HI PR	282	279	276	276	275	325	321	319	318	318	371	368	365	365	365	357	419	417	417	417	479	476	473	474	474
	LO PR	157	144	134	132	130	159	146	136	134	133	162	148	138	137	137	162	150	140	140	140	166	153	143	144	144
900	MBh†	27.75	25.40	23.68	23.36	23.27	26.42	24.16	22.50	22.32	22.31	26.10	22.85	21.26	21.30	21.30	24.55	21.48	19.97	20.23	20.23	22.87	20.02	18.59	19.07	19.07
	S/T†	0.54	0.76	0.78	0.99	1.00	0.55	0.77	0.80	1.00	1.00	0.55	0.79	0.82	1.00	1.00	0.56	0.82	0.84	1.00	1.00	0.58	0.85	0.87	1.00	1.00
	AMPS*	7.52	7.52	7.52	7.52	7.52	8.40	8.40	8.41	8.41	8.41	8.08	9.39	9.39	9.39	9.39	9.11	10.47	10.49	10.48	10.48	10.26	11.68	11.69	11.68	11.68
	HI PR	282	279	277	276	276	325	322	319	319	319	308	369	366	366	366	358	420	417	418	418	413	476	474	475	475
	LO PR	160	147	137	135	135	162	149	139	138	138	163	151	140	141	141	165	153	142	145	145	167	155	145	149	149

HEATING		24 Size Outdoor With FS(M,U)4X24**** Indoor Heating																							
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																							
		-3			7			17			27			37			47			57			67		
		Entering Indoor Temperature – Degrees F, Dry Bulb																							
CFM		65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75			
700	MBh†	9.58	9.29	8.96	11.98	11.70	11.40	14.58	14.30	14.02	17.51	17.18	16.85	20.82	20.47	20.14	24.20	23.95	23.63	27.14	26.95	26.71	30.15	30.01	29.80
	T/R	14.30	14.00	13.60	18.00	17.70	17.40	22.10	21.90	21.60	26.80	26.50	26.20	32.10	31.80	31.60	37.70	37.60	37.40	42.70	42.70	42.70	47.80	48.00	48.10
	AMPS*	6.62	6.93	7.24	6.91	7.24	7.59	7.21	7.58	7.96	7.60	7.98	8.37	8.08	8.48	8.90	8.51	8.97	9.44	8.95	9.42	9.91	9.44	9.95	10.46
	HI PR	233	250	267	248	265	283	265	283	301	286	305	324	312	331	352	336	358	381	361	384	408	389	414	438
	LO PR	39	39	39	50	50	50	62	63	63	77	77	77	92	93	93	108	110	111	122	124	125	136	138	140
800	MBh†	9.77	9.48	9.15	12.19	11.91	11.61	14.81	14.53	14.25	17.80	17.46	17.13	21.14	20.79	20.44	24.17	24.00	23.84	26.94	26.83	26.68	29.60	29.61	29.54
	T/R	12.70	12.50	12.10	16.00	15.70	15.50	19.50	19.30	19.10	23.70	23.40	23.20	28.30	28.10	27.90	32.70	32.70	32.80	36.70	36.80	37.00	40.60	41.00	41.20
	AMPS*	6.68	7.00	7.31	6.94	7.28	7.63	7.21	7.57	7.95	7.56	7.93	8.32	8.00	8.39	8.80	8.32	8.76	9.23	8.70	9.16	9.64	9.08	9.58	10.09
	HI PR	229	245	262	242	259	277	257	275	293	277	295	314	300	319	339	319	341	363	341	364	387	363	388	413
	LO PR	38	39	39	50	50	50	62	62	63	76	77	77	92	92	93	106	108	109	119	121	123	131	133	136
900	MBh†	9.94	9.65	9.33	12.37	12.09	11.80	15.03	14.73	14.45	18.06	17.71	17.37	21.40	21.06	20.71	24.07	23.97	23.82	26.59	26.60	26.53	28.87	29.03	29.10
	T/R	11.50	11.20	11.00	14.40	14.20	13.90	17.60	17.40	17.20	21.20	21.00	20.80	25.40	25.20	25.00	28.70	28.90	28.90	31.90	32.20	32.40	34.80	35.40	35.80
	AMPS*	6.77	7.08	7.40	7.00	7.34	7.69	7.25	7.60	7.98	7.57	7.94	8.32	7.95	8.37	8.77	8.22	8.66	9.10	8.55	9.00	9.48	8.84	9.34	9.85
	HI PR	226	242	259	237	254	272	251	269	287	270	288	306	290	310	330	307	328	350	326	348	371	343	368	393
	LO PR	38	39	39	49	50	50	62	62	63	76	77	77	92	92	93	104	106	107	115	118	120	125	129	132

COOLING		30 Size Outdoor With FS(M,U)4X30**** Indoor Cooling																								
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																								
		75					85					95					105					115				
		Entering Indoor Temperature – Degrees F, Wet Bulb																								
CFM		57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72
875	MBh†	27.76	29.00	29.57	31.74	34.69	26.66	27.62	28.15	30.23	33.05	25.50	26.17	26.66	28.64	31.30	24.27	24.66	25.10	26.97	29.50	22.94	23.06	23.41	25.17	27.53
	S/T‡	1.00	0.88	0.70	0.68	0.50	1.00	0.90	0.72	0.69	0.51	1.00	0.92	0.73	0.70	0.51	1.00	0.95	0.75	0.72	0.52	1.00	0.97	0.77	0.74	0.53
	AMPS*	10.55	10.56	10.56	10.58	10.61	11.89	11.90	11.91	11.92	11.95	13.39	13.39	13.40	13.41	13.43	15.04	15.03	15.05	15.06	15.07	16.83	16.83	16.83	16.84	16.85
	HI PR	278	280	280	283	287	321	322	323	326	330	368	369	370	373	377	419	420	421	424	429	475	475	476	480	484
	LO PR	121	126	128	138	150	124	128	130	140	153	127	130	132	142	155	131	133	135	145	158	135	136	137	147	161
1000	MBh†	29.75	30.51	31.06	33.24	36.21	28.58	29.09	29.58	31.67	34.50	27.34	27.60	28.01	30.00	32.68	26.03	26.06	26.39	28.26	30.80	24.61	24.61	24.64	26.39	28.76
	S/T‡	1.00	0.92	0.74	0.71	0.53	1.00	0.94	0.75	0.72	0.53	1.00	0.96	0.77	0.74	0.54	1.00	1.00	0.79	0.76	0.55	1.00	1.00	0.81	0.79	0.57
	AMPS*	9.22	9.23	9.23	9.25	9.28	10.57	10.57	10.58	10.59	10.62	12.05	12.06	12.06	12.08	12.10	13.70	13.70	13.71	13.71	13.73	15.49	15.49	15.50	15.50	15.50
	HI PR	280	281	281	284	288	323	323	324	327	332	369	370	370	374	378	421	421	422	425	430	477	477	477	480	485
	LO PR	126	129	131	141	154	129	131	133	143	156	133	134	135	145	159	136	136	138	148	161	140	140	140	150	164
1125	MBh†	29.72	30.09	30.58	32.77	35.75	28.49	28.65	29.04	31.14	33.98	27.18	27.19	27.43	29.41	32.11	25.80	25.80	25.75	27.61	30.18	24.31	24.31	23.96	25.69	28.08
	S/T‡	1.00	0.96	0.76	0.73	0.53	1.00	0.98	0.77	0.75	0.53	1.00	1.00	0.79	0.77	0.54	1.00	1.00	0.81	0.79	0.56	1.00	1.00	0.84	0.82	0.57
	AMPS*	11.00	11.00	11.00	11.02	11.05	12.34	12.35	12.35	12.37	12.39	13.83	13.83	13.83	13.85	13.87	15.47	15.47	15.47	15.48	15.50	17.27	17.27	17.26	17.26	17.28
	HI PR	281	282	282	285	289	324	324	325	328	332	371	371	371	375	379	422	422	422	426	431	479	479	478	481	486
	LO PR	130	132	134	144	157	134	134	136	146	159	137	137	138	148	161	141	141	140	150	164	145	145	142	153	166

HEATING		30 Size Outdoor With FS(M,U)4X30**** Indoor Heating																							
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																							
		-3			7			17			27			37			47			57			67		
		Entering Indoor Temperature – Degrees F, Dry Bulb																							
CFM		65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75
875	MBh†	12.02	11.62	11.19	15.08	14.71	14.32	18.33	17.98	17.61	21.82	21.49	21.13	25.66	25.25	24.86	29.99	29.55	29.13	34.77	34.31	33.84	39.34	38.81	38.33
	T/R	14.50	14.20	13.80	18.40	18.10	17.70	22.50	22.30	22.00	27.00	26.80	26.60	32.00	31.80	31.60	37.80	37.60	37.40	44.40	44.20	43.90	50.80	50.50	50.30
	AMPS*	8.17	8.58	8.99	8.56	9.01	9.46	8.97	9.45	9.95	9.44	9.96	10.49	10.01	10.54	11.10	10.71	11.28	11.87	11.46	12.11	12.77	12.11	12.74	13.40
	HI PR	235	251	268	251	268	286	269	287	306	291	310	329	316	336	356	347	368	390	381	404	428	412	435	459
	LO PR	36	37	37	47	47	48	59	59	60	72	73	73	87	88	88	104	104	105	123	123	124	142	143	144
1000	MBh†	12.26	11.85	11.42	15.33	14.97	14.58	18.61	18.26	17.90	22.12	21.79	21.44	26.04	25.64	25.23	30.47	30.00	29.56	35.11	34.70	34.25	39.58	39.17	38.72
	T/R	12.90	12.60	12.30	16.30	16.00	15.70	19.90	19.70	19.50	23.80	23.70	23.50	28.30	28.10	27.80	33.40	33.10	32.90	38.80	38.70	38.50	44.20	44.10	44.00
	AMPS*	8.24	8.65	9.07	8.59	9.03	9.49	8.95	9.43	9.92	9.36	9.87	10.40	9.86	10.39	10.93	10.49	11.05	11.62	11.05	11.67	12.32	11.67	12.29	12.93
	HI PR	231	247	264	245	262	280	262	280	298	281	300	319	304	323	344	332	353	374	359	382	406	388	411	435
	LO PR	36	37	37	47	47	47	59	59	59	72	73	73	87	88	88	103	104	104	122	123	124	140	141	142
1125	MBh†	12.47	12.07	11.64	15.56	15.20	14.82	18.86	18.51	18.15	22.38	22.05	21.72	26.41	25.97	25.55	30.87	30.39	29.93	35.28	34.94	34.55	39.69	39.35	38.96
	T/R	11.70	11.40	11.10	14.60	14.40	14.20	17.80	17.70	17.50	21.30	21.20	21.10	25.30	25.10	24.90	29.90	29.70	29.50	34.40	34.40	34.30	39.00	39.00	39.00
	AMPS*	8.34	8.75	9.17	8.64	9.09	9.55	8.96	9.44	9.94	9.33	9.84	10.36	9.81	10.31	10.85	10.38	10.91	11.48	10.80	11.41	12.04	11.38	11.99	12.62
	HI PR	228	244	260	241	258	275	256	273	292	273	292	311	295	314	334	321	341	362	343	366	389	370	393	417
	LO PR	36	37	37	47	47	47	59	59	59	72	72	73	87	87	88	103	104	104	121	122	123	138	139	141

COOLING		36 Size Outdoor With FSU4X36 Indoor Cooling																								
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																								
		75					85					95					105					115				
		Entering Indoor Temperature – Degrees F, Wet Bulb																								
CFM		57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72
1050	MBH†	33.16	33.94	34.54	37.01	40.35	31.86	32.35	32.90	35.27	38.48	30.46	30.69	31.16	33.42	36.50	28.98	28.99	29.32	31.48	34.43	27.35	27.35	27.34	29.38	32.16
	S/T†	1.00	0.91	0.72	0.69	0.50	1.00	0.93	0.73	0.70	0.51	1.00	0.95	0.75	0.72	0.52	1.00	1.00	0.77	0.74	0.53	1.00	1.00	0.79	0.77	0.54
	AMPS*	10.88	10.88	10.89	10.91	10.93	12.11	12.11	12.12	12.14	12.16	13.47	13.47	13.48	13.49	13.52	14.96	14.96	14.97	14.99	15.01	16.58	16.58	16.58	16.60	16.63
	HI PR	276	277	278	280	284	319	320	320	323	327	366	366	367	370	374	418	418	418	421	425	474	474	474	477	481
	LO PR	121	124	125	135	147	124	126	127	137	150	127	128	130	139	152	131	131	132	142	154	135	135	134	144	157
1200	MBH†	34.28	34.55	35.04	37.51	40.87	32.89	32.93	33.34	35.71	38.95	31.42	31.42	31.54	33.80	36.90	29.86	29.85	29.65	31.81	34.76	28.15	28.14	27.61	29.64	32.43
	S/T†	1.00	0.95	0.75	0.72	0.52	1.00	1.00	0.76	0.74	0.53	1.00	1.00	0.78	0.76	0.54	1.00	1.00	0.80	0.78	0.55	1.00	1.00	0.83	0.81	0.56
	AMPS*	11.15	11.15	11.15	11.17	11.20	12.38	12.38	12.39	12.40	12.43	13.74	13.74	13.74	13.76	13.78	15.23	15.23	15.23	15.25	15.28	16.85	16.85	16.85	16.87	16.90
	HI PR	278	278	279	281	285	321	321	321	324	328	367	367	368	370	374	419	419	419	422	426	475	475	475	478	481
	LO PR	126	127	128	138	150	129	129	130	140	152	132	132	132	142	155	136	136	134	144	157	140	140	137	147	159
1350	MBH†	35.18	35.17	35.42	37.88	41.26	33.73	33.73	33.67	36.03	39.28	32.19	32.18	31.82	34.08	37.18	30.55	30.55	29.89	32.04	34.99	28.77	28.77	27.81	29.83	32.60
	S/T†	1.00	1.00	0.78	0.75	0.53	1.00	1.00	0.80	0.77	0.54	1.00	1.00	0.82	0.79	0.55	1.00	1.00	0.84	0.82	0.57	1.00	1.00	0.87	0.85	0.58
	AMPS*	11.41	11.41	11.42	11.44	11.46	12.65	12.65	12.65	12.67	12.69	14.01	14.01	14.01	14.02	14.05	15.50	15.50	15.50	15.52	15.54	17.12	17.12	17.11	17.13	17.16
	HI PR	279	279	279	282	285	322	322	322	325	328	369	369	368	371	375	420	420	419	422	426	477	477	475	478	482
	LO PR	130	130	130	140	153	133	133	132	142	155	136	136	134	144	157	140	140	136	146	159	144	144	139	149	161

HEATING		36 Size Outdoor With FSU4X36 Indoor Heating																							
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																							
		-3			7			17			27			37			47			57			67		
		Entering Indoor Temperature – Degrees F, Dry Bulb																							
CFM		65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75
1050	MBH†	14.67	14.11	13.50	18.39	17.89	17.35	22.34	21.87	21.37	26.52	26.08	25.61	31.22	30.68	30.14	35.59	35.26	34.88	39.80	39.46	39.08	44.00	43.69	43.32
	T/R	13.80	13.40	12.90	17.40	17.10	16.70	21.30	21.10	20.70	25.50	25.30	25.10	30.30	30.00	29.70	34.80	34.80	34.70	39.20	39.20	39.20	43.70	43.80	43.80
	AMPS*	9.60	9.97	10.35	10.07	10.50	10.93	10.54	11.02	11.50	11.09	11.60	12.13	11.73	12.27	12.82	12.22	12.82	13.44	12.81	13.43	14.08	13.43	14.09	14.77
	HI PR	233	249	265	248	265	282	266	283	302	287	306	325	312	331	351	332	354	376	356	378	401	381	405	429
	LO PR	38	38	38	49	49	49	61	61	62	75	75	76	90	91	91	104	105	106	117	118	120	130	132	134
1200	MBH†	14.99	14.43	13.81	18.74	18.24	17.71	22.71	22.26	21.76	26.92	26.48	26.02	31.69	31.18	30.65	35.68	35.40	35.10	39.71	39.47	39.17	43.61	43.45	43.19
	T/R	12.30	12.00	11.50	15.50	15.20	14.90	18.90	18.70	18.40	22.50	22.40	22.20	26.70	26.50	26.30	30.30	30.30	30.30	33.90	34.00	34.10	37.50	37.70	37.80
	AMPS*	9.75	10.14	10.52	10.18	10.61	11.05	10.61	11.08	11.57	11.10	11.61	12.13	11.63	12.20	12.77	12.06	12.65	13.26	12.57	13.19	13.82	13.07	13.73	14.40
	HI PR	229	245	261	243	260	277	259	276	295	278	296	316	299	319	340	317	338	360	338	360	383	359	382	407
	LO PR	38	38	38	48	49	49	61	61	61	74	75	75	90	90	91	102	103	104	114	116	118	126	129	130
1350	MBH†	15.28	14.73	14.11	19.04	18.56	18.03	23.03	22.59	22.10	27.30	26.85	26.38	31.99	31.58	31.06	35.69	35.47	35.21	39.57	39.45	39.15	43.09	43.06	42.93
	T/R	11.10	10.80	10.50	13.90	13.70	13.40	17.00	16.80	16.60	20.20	20.10	19.90	23.90	23.80	23.60	26.80	26.80	26.90	29.80	30.00	30.10	32.70	32.90	33.10
	AMPS*	9.93	10.32	10.70	10.32	10.76	11.20	10.71	11.18	11.67	11.17	11.67	12.19	11.62	12.18	12.76	12.01	12.59	13.19	12.45	13.06	13.69	12.86	13.51	14.18
	HI PR	226	242	258	239	255	273	253	271	289	271	290	309	290	310	330	306	327	349	325	347	369	342	365	389
	LO PR	38	38	38	48	49	49	61	61	61	74	75	75	89	90	91	100	102	103	112	114	116	123	125	127

COOLING		42 Size Outdoor With FS(M,U)4X42**** Indoor Cooling																								
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																								
		75					85					95					105					115				
		Entering Indoor Temperature – Degrees F, Wet Bulb																								
CFM		57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72
1225	MBh†	39.05	40.45	41.23	44.21	48.26	37.54	38.56	39.29	42.14	46.00	35.93	36.58	37.24	39.96	43.63	34.22	34.53	35.09	37.67	41.15	32.37	32.38	32.79	35.20	38.47
	S/T‡	1.00	0.91	0.72	0.69	0.51	1.00	0.93	0.73	0.71	0.52	1.00	0.95	0.75	0.72	0.52	1.00	0.97	0.77	0.74	0.53	1.00	1.00	0.79	0.76	0.54
	AMPS*	13.22	13.25	13.26	13.31	13.40	14.67	14.68	14.69	14.74	14.81	16.27	16.28	16.29	16.33	16.39	18.03	18.04	18.05	18.08	18.14	19.98	19.98	19.99	20.01	20.05
	HI PR	277	278	279	281	284	320	321	321	324	327	367	367	368	371	374	418	419	419	422	426	475	475	475	478	482
	LO PR	125	129	131	141	154	128	131	133	143	156	131	133	135	145	159	135	136	137	148	161	139	139	140	150	164
1400	MBh†	40.48	41.22	41.93	44.93	48.98	38.87	39.28	39.91	42.77	46.64	37.16	37.28	37.78	40.50	44.18	35.34	35.34	35.55	38.12	41.64	33.38	33.37	33.17	35.57	38.84
	S/T‡	1.00	0.95	0.75	0.72	0.52	1.00	0.97	0.77	0.74	0.53	1.00	0.99	0.78	0.76	0.54	1.00	1.00	0.80	0.78	0.55	1.00	1.00	0.83	0.80	0.56
	AMPS*	13.57	13.58	13.59	13.64	13.72	15.01	15.01	15.02	15.07	15.14	16.60	16.60	16.61	16.65	16.72	18.37	18.37	18.37	18.41	18.47	20.31	20.31	20.31	20.33	20.36
	HI PR	278	279	279	282	285	321	321	322	325	328	368	368	369	372	375	420	420	420	423	427	476	476	476	478	482
	LO PR	130	132	134	144	158	133	134	136	146	160	136	137	138	148	162	140	140	140	150	164	144	144	142	153	167
1575	MBh†	41.65	41.88	42.44	45.43	49.51	39.96	39.96	40.35	43.21	47.10	38.15	38.15	38.16	40.87	44.56	36.24	36.24	35.87	38.43	41.96	34.18	34.17	33.43	35.82	39.08
	S/T‡	1.00	0.99	0.78	0.75	0.54	1.00	1.00	0.80	0.77	0.55	1.00	1.00	0.82	0.79	0.56	1.00	1.00	0.84	0.82	0.57	1.00	1.00	0.87	0.84	0.58
	AMPS*	13.90	13.91	13.91	13.97	14.05	15.34	15.34	15.34	15.40	15.47	16.93	16.93	16.93	16.97	17.04	18.69	18.69	18.69	18.73	18.79	20.63	20.63	20.62	20.65	20.68
	HI PR	279	280	280	282	286	322	322	323	325	329	369	369	369	372	376	421	421	421	423	428	477	477	476	479	483
	LO PR	135	135	137	147	160	138	138	138	149	162	141	141	140	151	164	144	144	142	153	166	148	148	145	155	169

HEATING		42 Size Outdoor With FS(M,U)4X42**** Indoor Heating																							
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																							
		-3			7			17			27			37			47			57			67		
		Entering Indoor Temperature – Degrees F, Dry Bulb																							
CFM		65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75
1225	MBh†	17.53	17.06	16.54	21.61	21.17	20.69	26.00	25.58	25.13	30.74	30.29	29.85	36.21	35.68	35.03	42.09	41.58	41.04	47.60	47.11	46.60	53.07	52.62	52.13
	T/R	14.50	14.30	13.90	18.00	17.80	17.60	21.80	21.70	21.50	26.00	25.90	25.70	30.90	30.70	30.40	36.30	36.10	36.00	41.40	41.30	41.20	46.60	46.60	46.50
	AMPS*	11.81	12.34	12.88	12.28	12.86	13.45	12.81	13.42	14.05	13.41	14.06	14.73	14.17	14.85	15.52	14.92	15.67	16.45	15.64	16.40	17.19	16.49	17.29	18.12
	HI PR	234	251	268	249	266	284	265	283	302	285	304	324	310	330	349	334	356	378	359	381	404	387	410	434
	LO PR	36	36	36	46	47	47	58	59	59	72	72	73	87	87	88	103	104	105	118	119	120	132	134	135
1400	MBh†	17.88	17.40	16.89	21.99	21.52	21.08	26.39	25.97	25.53	31.20	30.69	30.29	36.75	36.21	35.58	42.44	42.00	41.57	47.57	47.24	46.84	52.73	52.50	52.10
	T/R	12.90	12.70	12.40	16.00	15.80	15.60	19.30	19.20	19.00	23.00	22.80	22.70	27.30	27.10	26.90	31.80	31.70	31.60	35.90	35.90	35.90	40.00	40.20	40.30
	AMPS*	11.97	12.51	13.05	12.40	12.98	13.57	12.87	13.47	14.10	13.41	14.04	14.71	14.11	14.77	15.43	14.69	15.42	16.18	15.33	16.08	16.86	16.04	16.84	17.65
	HI PR	230	246	263	243	260	278	258	276	295	276	294	314	298	318	338	318	339	362	340	362	385	364	387	411
	LO PR	36	36	36	46	47	47	58	59	59	72	72	73	87	87	88	102	103	104	115	117	118	129	131	132
1575	MBh†	18.21	17.74	17.21	22.32	21.88	21.41	26.75	26.32	25.90	31.61	31.11	30.67	37.22	36.68	36.15	42.50	42.19	41.81	47.37	47.15	46.84	52.15	52.04	51.83
	T/R	11.70	11.50	11.20	14.40	14.20	14.00	17.30	17.20	17.10	20.60	20.50	20.30	24.40	24.30	24.10	28.10	28.10	28.10	31.50	31.60	31.70	34.90	35.10	35.30
	AMPS*	12.17	12.71	13.25	12.55	13.13	13.72	12.98	13.59	14.21	13.48	14.10	14.76	14.14	14.79	15.48	14.60	15.31	16.05	15.17	15.91	16.68	15.78	16.56	17.36
	HI PR	227	243	260	238	256	273	252	270	289	269	287	307	290	309	329	307	327	349	326	348	370	347	370	393
	LO PR	36	36	36	46	47	47	58	59	59	72	72	72	87	87	87	100	102	103	113	115	116	125	127	129

COOLING		48 Size Outdoor With FS(M,U)4X48**** Indoor Cooling																								
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																								
		75					85					95					105					115				
		Entering Indoor Temperature – Degrees F, Wet Bulb																								
CFM		57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72
1400	MBh†	45.85	47.48	48.43	52.07	56.99	43.97	45.13	46.02	49.50	54.20	42.02	42.72	43.52	46.83	51.28	39.96	40.24	40.92	44.04	48.25	37.77	37.77	38.19	41.11	45.04
	S/T‡	1.00	0.89	0.71	0.68	0.50	1.00	0.91	0.72	0.69	0.51	1.00	0.94	0.74	0.71	0.51	1.00	0.96	0.76	0.73	0.52	1.00	1.00	0.78	0.75	0.53
	AMPS*	14.69	14.66	14.65	14.59	14.48	16.48	16.47	16.46	16.43	16.35	18.42	18.42	18.42	18.40	18.35	20.52	20.52	20.52	20.53	20.51	22.77	22.77	22.78	22.81	22.83
	HI PR	271	272	273	276	281	313	314	315	318	323	359	360	360	364	369	409	409	410	414	420	464	464	465	469	474
	LO PR	126	130	132	142	155	129	132	134	144	158	133	135	136	147	160	136	137	139	149	162	140	140	141	151	165
1600	MBh†	47.61	48.44	49.31	52.98	57.90	45.61	46.03	46.79	50.29	55.00	43.52	43.55	44.18	47.50	51.96	41.33	41.33	41.48	44.61	48.82	39.01	39.00	38.66	41.57	45.51
	S/T‡	1.00	0.93	0.74	0.71	0.51	1.00	0.96	0.75	0.73	0.52	1.00	1.00	0.77	0.74	0.53	1.00	1.00	0.79	0.77	0.54	1.00	1.00	0.82	0.79	0.55
	AMPS*	15.04	15.02	15.01	14.94	14.83	16.84	16.84	16.83	16.79	16.70	18.80	18.80	18.80	18.77	18.72	20.91	20.91	20.91	20.91	20.88	23.17	23.17	23.17	23.19	23.21
	HI PR	273	273	274	277	282	315	315	316	320	324	361	361	362	365	370	411	411	411	416	421	466	466	466	470	476
	LO PR	131	133	135	145	159	135	136	137	147	161	138	138	139	150	163	142	142	141	152	166	145	145	144	154	168
1800	MBh†	49.07	49.26	49.95	53.62	58.55	46.96	46.95	47.35	50.84	55.56	44.75	44.75	44.66	47.96	52.43	42.44	42.44	41.88	44.99	49.21	39.99	39.99	38.98	41.88	45.80
	S/T‡	1.00	0.97	0.77	0.74	0.53	1.00	1.00	0.78	0.76	0.54	1.00	1.00	0.80	0.78	0.55	1.00	1.00	0.83	0.80	0.56	1.00	1.00	0.86	0.83	0.58
	AMPS*	15.39	15.38	15.38	15.30	15.18	17.20	17.20	17.20	17.15	17.06	19.17	19.17	19.17	19.15	19.08	21.29	21.29	21.29	21.29	21.25	23.56	23.56	23.56	23.58	23.58
	HI PR	274	274	275	278	282	317	317	317	320	325	363	363	362	366	371	413	413	412	416	421	468	468	467	471	476
	LO PR	136	137	138	148	162	139	139	140	150	164	142	142	142	152	166	146	146	144	154	168	150	150	146	156	170

HEATING		48 Size Outdoor With FS(M,U)4X48**** Indoor Heating																							
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																							
		-3			7			17			27			37			47			57			67		
		Entering Indoor Temperature – Degrees F, Dry Bulb																							
CFM		65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75			
1400	MBH†	20.81	20.34	19.84	25.42	24.97	24.49	30.38	29.94	29.50	35.87	35.33	34.84	42.17	41.59	41.03	48.31	47.84	47.37	54.67	54.25	53.77			
	T/R	15.10	14.80	14.60	18.50	18.30	18.10	22.30	22.10	22.00	26.50	26.30	26.20	31.40	31.30	31.10	36.30	36.30	36.20	41.50	41.50	41.50			
	AMPS*	13.31	13.89	14.48	13.85	14.48	15.12	14.43	15.10	15.80	15.07	15.78	16.53	15.76	16.58	17.42	16.46	17.28	18.13	17.33	18.19	19.09			
	HI PR	234	250	268	247	264	283	263	282	300	283	302	322	305	326	348	329	350	371	356	378	401			
	LO PR	37	37	37	47	48	48	60	60	60	73	74	74	88	89	89	103	104	105	118	119	120			
1600	MBH†	21.19	20.73	20.23	25.83	25.38	24.91	30.81	30.38	29.94	36.40	0.00	35.31	42.62	42.17	41.61	48.38	48.00	47.60	52.00	52.90	53.57			
	T/R	13.40	13.20	13.00	16.40	16.20	16.10	19.70	19.60	19.50	23.40	-70.00	23.10	27.60	27.60	27.40	31.60	31.60	31.60	34.10	35.00	35.80			
	AMPS*	13.51	14.09	14.69	14.00	14.63	15.27	14.51	15.19	15.87	15.09	0.00	16.52	15.64	16.42	17.23	16.28	17.08	17.91	16.66	17.67	18.71			
	HI PR	229	246	263	241	258	277	256	274	293	274	-15	312	293	313	334	314	335	356	327	354	382			
	LO PR	37	37	37	47	48	48	60	60	60	73	-15	74	88	88	89	101	102	103	109	114	118			
1800	MBH†	21.55	21.08	20.59	26.21	25.76	25.29	31.20	30.78	30.34	36.89	36.32	35.77	42.78	42.48	42.06	48.08	47.99	47.67	49.39	50.45	51.31			
	T/R	12.10	11.90	11.70	14.70	14.60	14.50	17.60	17.60	17.50	21.00	20.80	20.70	24.50	24.50	24.50	27.70	27.90	28.00	28.50	29.40	30.20			
	AMPS*	13.75	14.33	14.92	14.19	14.82	15.46	14.66	15.33	16.01	15.21	15.89	16.61	15.66	16.42	17.21	16.21	17.02	17.84	16.27	17.24	18.24			
	HI PR	226	242	260	236	254	272	250	268	287	268	286	305	284	304	324	303	324	345	306	332	358			
	LO PR	37	37	37	47	48	48	59	60	60	73	73	74	87	88	89	99	101	102	101	106	110			

COOLING		60 Size Outdoor With FS(M,U)4X60**** Indoor Cooling																								
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																								
		75					85					95					105					115				
		Entering Indoor Temperature – Degrees F, Wet Bulb																								
CFM		57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72	57	62	63††	67	72
1750	MBH†	57.36	59.39	60.53	64.73	70.28	55.12	56.60	57.68	61.72	67.10	52.73	53.67	54.66	58.50	63.63	50.21	50.63	51.50	55.15	60.01	47.45	47.46	48.09	51.50	56.06
	S/T‡	1.00	0.89	0.71	0.68	0.50	1.00	0.91	0.72	0.70	0.51	1.00	0.94	0.74	0.71	0.52	1.00	0.96	0.76	0.73	0.52	1.00	1.00	0.78	0.75	0.54
	AMPS*	19.05	19.15	19.19	19.39	19.65	21.05	21.12	21.17	21.37	21.63	23.25	23.30	23.35	23.55	23.81	25.67	25.69	25.73	25.94	26.21	28.32	28.32	28.35	28.56	28.82
	HI PR	285	287	288	292	297	329	330	331	336	341	376	377	378	383	389	428	429	430	435	441	485	485	486	491	497
	LO PR	125	129	131	141	155	128	131	133	144	157	131	134	136	146	159	135	136	138	148	162	139	139	140	150	164
2000	MBH†	59.46	60.48	61.54	65.72	71.26	57.07	57.63	58.58	62.60	67.97	54.53	54.66	55.44	59.26	64.37	51.85	51.85	52.17	55.79	60.64	48.92	48.91	48.63	52.01	56.56
	S/T‡	1.00	0.94	0.74	0.71	0.52	1.00	0.96	0.75	0.73	0.52	1.00	0.99	0.77	0.75	0.53	1.00	1.00	0.79	0.77	0.54	1.00	1.00	0.82	0.79	0.56
	AMPS*	19.62	19.67	19.71	19.91	20.17	21.62	21.65	21.69	21.89	22.15	23.82	23.83	23.86	24.06	24.33	26.24	26.24	26.25	26.45	26.72	28.89	28.89	28.86	29.07	29.32
	HI PR	287	288	289	293	298	331	332	333	337	342	379	379	380	384	390	431	431	431	436	442	488	488	487	492	498
	LO PR	130	133	135	145	159	133	135	137	147	160	137	137	138	149	163	140	140	141	151	165	144	144	143	153	167
2250	MBH†	61.15	61.41	62.26	66.42	71.95	58.65	58.65	59.21	63.21	68.56	55.97	55.97	55.98	59.77	64.87	53.16	53.15	52.62	56.21	61.04	50.07	50.06	49.00	52.34	56.86
	S/T‡	1.00	0.97	0.77	0.74	0.53	1.00	1.00	0.78	0.76	0.54	1.00	1.00	0.80	0.78	0.55	1.00	1.00	0.83	0.81	0.56	1.00	1.00	0.86	0.83	0.58
	AMPS*	20.17	20.18	20.22	20.42	20.67	22.17	22.17	22.19	22.39	22.65	24.37	24.37	24.36	24.57	24.83	26.79	26.79	26.75	26.95	27.21	29.43	29.43	29.36	29.56	29.82
	HI PR	289	290	290	294	299	333	333	334	338	343	381	381	381	385	391	433	433	432	437	443	490	490	488	493	499
	LO PR	135	136	137	148	161	138	138	139	149	163	141	141	141	151	165	145	145	143	153	167	149	149	145	156	170

HEATING		60 Size Outdoor With FS(M,U)4X60**** Indoor Heating																							
		Outdoor Ambient Temperature – Degrees F, Dry Bulb																							
		-3			7			17			27			37			47			57			67		
		Entering Indoor Temperature – Degrees F, Dry Bulb																							
CFM		65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75	65	70	75
1750	MBh†	24.57	23.76	22.90	30.47	29.75	28.96	36.69	36.02	35.29	43.32	42.67	42.00	50.72	49.99	49.25	58.76	58.00	57.22	66.48	65.66	64.84	74.57	73.71	72.82
	T/R	14.10	13.70	13.30	17.60	17.30	17.00	21.30	21.10	20.80	25.30	25.20	25.00	29.90	29.70	29.50	35.00	34.80	34.60	39.90	39.70	39.60	45.20	45.00	44.90
	AMPS*	16.03	16.71	17.40	16.75	17.50	18.27	17.49	18.29	19.12	18.30	19.16	20.05	19.25	20.16	21.10	20.05	20.99	21.98	21.05	22.04	23.07	22.17	23.21	24.28
	HI PR	230	246	263	243	260	277	258	276	294	276	294	314	295	315	335	314	334	355	337	358	380	363	385	408
	LO PR	34	35	35	44	45	45	56	56	57	68	69	69	83	83	84	97	98	99	112	113	114	127	128	129
2000	MBh†	25.10	24.29	23.43	31.01	30.31	29.54	37.29	36.63	35.89	43.97	43.31	42.66	51.55	50.73	50.01	59.18	58.52	57.81	66.76	66.06	65.31	73.14	73.11	72.79
	T/R	12.50	12.20	11.90	15.60	15.40	15.10	18.90	18.70	18.50	22.40	22.20	22.10	26.40	26.20	26.10	30.60	30.50	30.40	34.70	34.70	34.60	38.30	38.70	38.80
	AMPS*	16.31	16.99	17.69	16.96	17.71	18.49	17.62	18.42	19.25	18.34	19.19	20.08	19.14	20.07	21.03	19.86	20.79	21.76	20.72	21.70	22.72	21.46	22.57	23.69
	HI PR	226	242	259	237	254	272	251	269	287	267	285	304	284	303	324	300	320	341	320	341	363	337	361	385
	LO PR	34	35	35	44	45	45	56	56	56	68	69	69	83	83	83	96	97	98	110	111	112	122	124	126
2250	MBh†	25.59	24.78	23.92	31.52	30.81	30.05	37.81	37.15	36.44	44.55	43.89	43.22	52.26	51.46	50.75	59.42	58.83	58.23	66.69	66.14	65.53	70.31	70.72	70.80
	T/R	11.30	11.10	10.80	14.00	13.90	13.60	16.90	16.80	16.60	20.10	19.90	19.80	23.70	23.50	23.40	27.10	27.10	27.00	30.60	30.60	30.60	32.40	32.90	33.20
	AMPS*	16.63	17.30	18.01	17.22	17.97	18.75	17.82	18.62	19.44	18.49	19.33	20.20	19.15	20.07	21.01	19.82	20.75	21.70	20.57	21.54	22.54	20.88	21.99	23.12
	HI PR	222	239	256	233	250	267	246	263	281	260	278	297	274	294	314	290	310	330	307	328	350	315	339	363
	LO PR	34	35	35	44	45	45	56	56	56	68	69	69	82	83	83	95	96	97	108	109	111	114	117	120

COOLING Multiplying Factors for other Indoor Combinations

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
(C,H,T)4H318											
*FS(M,U)4X18***		1.00	1.00	EHD4X24A**	*9MPV075	1.05	0.96	FEM4P24**A*		1.02	0.93
ED*4X18B**	*8MPV050	1.02	0.97	EHD4X24A**	*9MVX040	1.05	0.96	FEM4X18***		1.02	0.93
ED*4X18B**	MV08B15**B*	1.01	0.92	EHD4X24A**	*9MVX060	1.05	0.96	FEM4X24***		1.03	0.94
ED*4X24B**	*8MPV050	1.05	0.96	EHD4X24A**	MV08B15**B*	1.03	0.90	FS(M,U)4P18**A*		1.02	0.97
ED*4X24B**	MV08B15**B*	1.02	0.91	EHD4X24A**		1.02	1.02	FS(M,U)4P24**A*		1.02	0.98
ED*4X24B**		1.01	1.01	EMA4X24D**		1.02	1.02	FSA4X18**A*		1.00	1.05
ED*4X24F**		1.01	1.01	FEA4X18**A*		1.01	0.92	FSA4X24**A*		1.01	1.01
EHD4X24A**	*8MPV050	1.05	0.96	FEA4X24**A*		1.03	0.90	FVM4X24***		1.03	0.90
EHD4X24A**	*9MPV050	1.05	0.96	FEM4P18**A*		1.02	0.93	FXM4X18**A*		1.04	0.91
								FXM4X24**A*		1.04	0.91
(C,H,T)4H324											
*FS(M,U)4X24***		1.00	1.00	EHD4X24A**	*8MPV075	1.02	0.96	EHD4X30A**	*9MVX040	1.04	0.97
ED*4X24B**	*8MPV050	1.02	0.98	EHD4X24A**	*8MPV100	1.04	0.97	EHD4X30A**	*9MVX060	1.04	0.98
ED*4X24B**	MV08B15**B*	1.02	0.92	EHD4X24A**	*8MPV125	1.03	0.96	EHD4X30A**	*9MVX080	1.05	0.95
ED*4X24B**		1.01	1.01	EHD4X24A**	*9MPV050	1.02	0.98	EHD4X30A**	*9MVX100	1.05	0.95
ED*4X24F**	*8MPV075	1.03	0.96	EHD4X24A**	*9MPV075	1.02	0.98	EHD4X30A**	MV08B15**B*	1.04	0.93
ED*4X24F**	*9MPV050	1.02	0.96	EHD4X24A**	*9MPV100	1.03	0.96	EHD4X30A**	MV12F19**B*	1.04	0.93
ED*4X24F**	*9MPV075	1.03	0.96	EHD4X24A**	*9MPV125	1.04	0.97	EHD4X30A**		1.02	1.02
ED*4X24F**	*9MVX040	1.02	0.96	EHD4X24A**	*9MVX040	1.02	0.96	EMA4X24D**		1.01	1.01
ED*4X24F**	*9MVX060	1.03	0.96	EHD4X24A**	*9MVX060	1.03	0.96	FEA4X24**A*		1.00	0.94
ED*4X24F**	MV12F19**B*	1.02	0.92	EHD4X24A**	*9MVX080	1.04	0.98	FEA4X30**A*		1.01	0.95
ED*4X24F**		1.01	1.01	EHD4X24A**	*9MVX100	1.04	0.97	FEM4P24**A*		1.00	0.96
ED*4X30B**	*8MPV050	1.04	0.97	EHD4X24A**	MV08B15**B*	1.03	0.92	FEM4P30**A*		1.04	0.97
ED*4X30B**	MV08B15**B*	1.03	0.92	EHD4X24A**	MV12F19**B*	1.03	0.92	FEM4X24***		1.02	0.96
ED*4X30B**		1.02	1.02	EHD4X24A**		1.01	1.01	FEM4X30***		1.04	0.96
ED*4X30F**	*8MPV075	1.04	0.98	EHD4X30A**	*8MPV050	1.04	0.97	FS(M,U)4P24**A*		1.03	0.99

> Indicates Tested Indoor Model

- continued on next page -

COOLING Multiplying Factors for other Indoor Combinations (continued)

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
ED*4X30F**	*9MPV050	1.04	0.97	EHD4X30A**	*8MPV075	1.04	0.98	FS(M,U)4P30**A*		1.04	1.00
ED*4X30F**	*9MPV075	1.04	0.97	EHD4X30A**	*8MPV100	1.05	0.95	FS(M,U)4X30****		1.02	1.02
ED*4X30F**	*9MVX040	1.04	0.97	EHD4X30A**	*8MPV125	1.06	0.96	FVM4X24****		1.03	0.92
ED*4X30F**	*9MVX060	1.04	0.98	EHD4X30A**	*9MPV050	1.04	0.97	FVM4X36****		1.03	0.92
ED*4X30F**	MV12F19**B*	1.03	0.92	EHD4X30A**	*9MPV075	1.04	0.97	FXM4X24**A*		1.04	0.97
ED*4X30F**		1.02	1.02	EHD4X30A**	*9MPV100	1.04	0.97	FXM4X30**A*		1.04	0.98
EHD4X24A**	*8MPV050	1.02	0.98	EHD4X30A**	*9MPV125	1.05	0.99				
(C,H,T)4H330											
*FS(M,U)4P30**A*		1.00	1.00	EHD4X30A**	*8MPV075	1.00	1.00	EHD4X36A**	*9MPV125	1.00	0.96
ED*4X30B**	MV08B15**B*	1.00	0.96	EHD4X30A**	*8MPV100	1.00	1.00	EHD4X36A**	*9MVX040	1.00	1.00
ED*4X30F**	*8MPV075	1.00	1.00	EHD4X30A**	*8MPV125	1.00	0.96	EHD4X36A**	*9MVX060	1.00	1.00
ED*4X30F**	*9MPV050	1.00	1.00	EHD4X30A**	*9MPV050	1.00	1.00	EHD4X36A**	*9MVX080	1.00	0.96
ED*4X30F**	*9MPV075	1.00	1.00	EHD4X30A**	*9MPV075	1.00	1.00	EHD4X36A**	*9MVX100	1.00	0.96
ED*4X30F**	*9MVX040	1.00	1.00	EHD4X30A**	*9MPV100	1.00	1.00	EHD4X36A**	MV08B15**B*	1.00	0.96
ED*4X30F**	*9MVX060	1.00	1.00	EHD4X30A**	*9MPV125	1.00	1.00	EHD4X36A**	MV12F19**B*	1.00	0.96
ED*4X30F**	MV12F19**B*	1.00	0.96	EHD4X30A**	*9MVX040	1.00	1.00	FEA4X30**A*		1.00	1.00
ED*4X36B**	MV08B15**B*	1.00	0.96	EHD4X30A**	*9MVX060	1.00	1.00	FEA4X36**A*		1.00	1.00
ED*4X36F**	*8MPV075	1.00	1.00	EHD4X30A**	*9MVX080	1.00	1.00	FEM4P30**A*		1.00	1.00
ED*4X36F**	*9MPV050	1.00	1.00	EHD4X30A**	*9MVX100	1.00	1.00	FEM4P30**A*		1.00	1.00
ED*4X36F**	*9MPV075	1.00	1.00	EHD4X30A**	MV08B15**B*	1.00	0.96	FEM4P36**A*		1.00	1.00
ED*4X36F**	*9MVX040	1.00	1.00	EHD4X30A**	MV12F19**B*	1.00	0.96	FEM4P36**A*		1.00	1.00
ED*4X36F**	*9MVX060	1.00	1.00	EHD4X36A**	*8MPV050	1.00	1.00	FEM4X30****		1.00	1.00
ED*4X36F**	MV12F19**B*	1.00	0.96	EHD4X36A**	*8MPV075	1.00	0.96	FEM4X36****		1.00	1.00
ED*4X36J**	*8MPV100	1.00	0.96	EHD4X36A**	*8MPV100	1.00	0.96	FS(M,U)4P30**A*		1.00	1.00
ED*4X36J**	*8MPV125	1.00	0.96	EHD4X36A**	*8MPV125	1.00	0.96	FVM4X24****		1.00	0.96
ED*4X36J**	*9MPV100	1.00	0.96	EHD4X36A**	*9MPV050	1.00	1.00	FVM4X36****		1.00	0.96
ED*4X36J**	*9MVX080	1.00	0.96	EHD4X36A**	*9MPV075	1.00	1.00	FVM4X48****		1.00	0.96

> Indicates Tested Indoor Model

- continued on next page -

COOLING Multiplying Factors for other Indoor Combinations (continued)

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
EHD4X30A**	*8MPV050	1.00	1.00	EHD4X36A**	*9MPV100	1.00	0.96	FXM4X30**A*		1.00	0.96
								FXM4X36**A*		1.00	0.96
(C,H,T)4H336											
*FS(M,U)4P36**A*		1.00	1.00	ED*4X42J**	MV16J22**B*	1.00	0.96	EHD4X42A**	*9MPV075	1.00	0.96
ED*4X36B**	*8MPV050	0.99	0.99	ED*4X42J**		1.00	1.00	EHD4X42A**	*9MPV100	1.00	0.96
ED*4X36B**	MV08B15**B*	0.99	0.95	ED*4X42L**	*9MPV125	1.00	0.96	EHD4X42A**	*9MPV125	1.00	0.96
ED*4X36B**		0.99	0.99	ED*4X42L**	*9MVX100	1.00	0.96	EHD4X42A**	*9MVX040	1.00	1.00
ED*4X36F**	*8MPV075	0.99	0.95	ED*4X42L**	MV20L24**B*	1.00	0.96	EHD4X42A**	*9MVX060	1.00	0.96
ED*4X36F**	*9MPV050	0.99	0.99	ED*4X42L**		1.00	1.00	EHD4X42A**	*9MVX080	1.00	0.96
ED*4X36F**	*9MPV075	0.99	0.99	EHD4X36A**	*8MPV050	0.99	0.99	EHD4X42A**	*9MVX100	1.00	0.96
ED*4X36F**	*9MVX040	0.99	0.99	EHD4X36A**	*8MPV075	0.99	0.95	EHD4X42A**	MV08B15**B*	1.00	0.96
ED*4X36F**	*9MVX060	0.99	0.99	EHD4X36A**	*8MPV100	0.99	0.95	EHD4X42A**	MV12F19**B*	1.00	0.92
ED*4X36F**	MV12F19**B*	0.99	0.95	EHD4X36A**	*8MPV125	0.99	0.95	EHD4X42A**	MV16J22**B*	1.00	0.92
ED*4X36F**		0.99	0.99	EHD4X36A**	*9MPV050	0.99	0.99	EHD4X42A**	MV20L24**B*	1.00	0.92
ED*4X36J**	*8MPV100	0.99	0.95	EHD4X36A**	*9MPV075	0.99	0.95	EHD4X42A**		1.00	1.00
ED*4X36J**	*8MPV125	0.99	0.95	EHD4X36A**	*9MPV100	0.99	0.95	EMA4X36D**		0.99	0.99
ED*4X36J**	*9MPV100	0.99	0.95	EHD4X36A**	*9MPV125	0.99	0.95	FEA4X36**A*		1.00	1.00
ED*4X36J**	*9MVX080	0.99	0.95	EHD4X36A**	*9MVX040	0.99	0.99	FEM4P36**A*		1.00	1.00
ED*4X36J**	MV16J22**B*	0.99	0.95	EHD4X36A**	*9MVX060	0.99	0.95	FEM4P36**A*		1.00	1.00
ED*4X36J**		0.99	0.99	EHD4X36A**	*9MVX080	0.99	0.95	FEM4P42**A*		1.00	1.00
ED*4X42F**	*8MPV075	1.00	0.96	EHD4X36A**	*9MVX100	0.99	0.95	FEM4P42**A*		1.00	0.96
ED*4X42F**	*9MPV050	1.00	1.00	EHD4X36A**	MV08B15**B*	0.99	0.95	FEM4X36****		1.00	0.96
ED*4X42F**	*9MPV075	1.00	1.00	EHD4X36A**	MV12F19**B*	0.99	0.91	FEM4X42****		1.00	0.96
ED*4X42F**	*9MVX040	1.00	1.00	EHD4X36A**	MV16J22**B*	0.99	0.91	FS(M,U)4P36**A*		1.00	1.00
ED*4X42F**	*9MVX060	1.00	1.00	EHD4X36A**	MV20L24**B*	0.99	0.91	FS(M,U)4P42**A*		1.00	1.00
ED*4X42F**	MV12F19**B*	1.00	0.96	EHD4X36A**		0.99	0.99	FS(M,U)4P42**A*		1.00	1.00
ED*4X42F**		1.00	1.00	EHD4X42A**	*8MPV050	1.00	1.00	FS(M,U)4X42****		1.00	1.00

> Indicates Tested Indoor Model

- continued on next page -

COOLING Multiplying Factors for other Indoor Combinations (continued)											
Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
ED*4X42J**	*8MPV100	1.00	0.96	EHD4X42A**	*8MPV075	1.00	0.96	FSM4X36****		1.00	1.00
ED*4X42J**	*8MPV125	1.00	0.96	EHD4X42A**	*8MPV100	1.00	0.96	FVM4X24****		1.00	0.96
ED*4X42J**	*9MPV100	1.00	0.96	EHD4X42A**	*8MPV125	1.00	0.96	FVM4X36****		1.00	0.96
ED*4X42J**	*9MVX080	1.00	0.96	EHD4X42A**	*9MPV050	1.00	1.00	FVM4X48****		1.01	0.92
								FXM4X36**A*		1.00	0.96
								FXM4X42**A*		1.00	0.96
(C,H,T)4H342											
*FS(M,U)4P42**A*		1.00	1.00	ED*4X48J**		1.00	1.00	EHD4X48A**	*9MVX060	1.00	0.96
ED*4X42F**	*8MPV075	0.98	0.98	ED*4X48L**	*9MPV125	1.00	0.96	EHD4X48A**	*9MVX080	1.00	0.96
ED*4X42F**	MV12F19**B*	0.98	0.93	ED*4X48L**	*9MVX100	1.00	0.96	EHD4X48A**	*9MVX100	1.00	0.96
ED*4X42F**		0.98	0.98	ED*4X48L**	MV20L24**B*	1.00	0.96	EHD4X48A**	MV12F19**B*	1.00	0.92
ED*4X42J**	*8MPV100	0.98	0.93	ED*4X48L**		1.00	1.00	EHD4X48A**	MV16J22**B*	1.00	0.92
ED*4X42J**	*8MPV125	0.98	0.93	EHD4X42A**	*8MPV075	0.98	0.93	EHD4X48A**	MV20L24**B*	1.00	0.92
ED*4X42J**	*9MPV100	0.98	0.93	EHD4X42A**	*8MPV100	0.98	0.93	EHD4X48A**		1.00	1.00
ED*4X42J**	*9MVX080	0.98	0.93	EHD4X42A**	*8MPV125	0.98	0.93	EMA4X48D**		1.00	1.00
ED*4X42J**	MV16J22**B*	0.98	0.93	EHD4X42A**	*9MPV075	0.98	0.98	FEM4P42**A*		1.00	1.00
ED*4X42J**		0.98	0.98	EHD4X42A**	*9MPV100	0.98	0.93	FEM4P42**A*		1.00	0.96
ED*4X42L**	*9MPV125	0.98	0.93	EHD4X42A**	*9MPV125	0.98	0.93	FEM4P48**A*		1.00	1.00
ED*4X42L**	*9MVX100	0.98	0.93	EHD4X42A**	*9MVX060	0.98	0.98	FEM4P48**A*		1.00	0.96
ED*4X42L**	MV20L24**B*	0.98	0.93	EHD4X42A**	*9MVX080	0.98	0.93	FEM4X42****		1.00	0.96
ED*4X42L**		0.98	0.98	EHD4X42A**	*9MVX100	0.98	0.93	FEM4X48****		1.00	0.92
ED*4X48F**	*8MPV075	1.00	0.96	EHD4X42A**	MV12F19**B*	0.98	0.93	FS(M,U)4P42**A*		1.00	1.00
ED*4X48F**	*9MPV075	0.98	0.98	EHD4X42A**	MV16J22**B*	0.98	0.93	FS(M,U)4P48**A*		1.00	1.00
ED*4X48F**	*9MVX060	1.00	1.00	EHD4X42A**	MV20L24**B*	0.98	0.93	FS(M,U)4P48**A*		1.00	1.00
ED*4X48F**	MV12F19**B*	1.00	0.92	EHD4X42A**		0.98	0.98	FS(M,U)4X42****		0.98	0.98
ED*4X48F**		1.00	1.00	EHD4X48A**	*8MPV075	1.00	0.96	FS(M,U)4X48****		1.00	1.00
ED*4X48J**	*8MPV100	1.00	0.96	EHD4X48A**	*8MPV100	1.00	0.96	FVM4X36****		0.98	0.93

> Indicates Tested Indoor Model

- continued on next page -

COOLING Multiplying Factors for other Indoor Combinations (continued)

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
ED*4X48J**	*8MPV125	1.00	0.96	EHD4X48A**	*8MPV125	1.00	0.96	FVM4X48***		1.00	0.92
ED*4X48J**	*9MPV100	1.00	0.96	EHD4X48A**	*9MPV075	1.00	1.00	FXM4X42**A*		1.00	0.96
ED*4X48J**	*9MVX080	1.00	0.96	EHD4X48A**	*9MPV100	1.00	0.96	FXM4X48**A*		1.00	0.92
ED*4X48J**	MV16J22**B*	1.00	0.96	EHD4X48A**	*9MPV125	1.00	0.96				
(C,H,T)4H348											
*FS(M,U)4P48**A*		1.00	1.00	ED*4X60J**		1.00	1.00	EHD4X60A**	*9MPV125	1.00	0.96
ED*4X48F**		0.98	0.98	ED*4X60L**	*9MPV125	1.00	0.96	EHD4X60A**	*9MVX080	1.00	0.96
ED*4X48J**	*8MPV100	0.98	0.94	ED*4X60L**	*9MVX100	1.00	0.96	EHD4X60A**	*9MVX100	1.00	0.96
ED*4X48J**	*8MPV125	0.98	0.94	ED*4X60L**	MV20L24**B*	1.00	0.96	EHD4X60A**	MV16J22**B*	1.00	0.96
ED*4X48J**	*9MPV100	0.98	0.98	ED*4X60L**		1.00	1.00	EHD4X60A**	MV20L24**B*	1.00	0.96
ED*4X48J**	*9MVX080	0.98	0.98	EHD4X48A**	*8MPV100	0.98	0.94	EHD4X60A**		1.00	1.00
ED*4X48J**	MV16J22**B*	0.98	0.94	EHD4X48A**	*8MPV125	0.98	0.94	FEM4P48**A*		0.98	0.98
ED*4X48J**		0.98	0.98	EHD4X48A**	*9MPV100	0.98	0.94	FEM4P48**A*		0.98	0.98
ED*4X48L**	*9MPV125	0.98	0.94	EHD4X48A**	*9MPV125	0.98	0.94	FEM4P60**A*		1.00	1.00
ED*4X48L**	*9MVX100	0.98	0.94	EHD4X48A**	*9MVX080	0.98	0.94	FEM4P60**A*		1.00	0.96
ED*4X48L**	MV20L24**B*	0.98	0.94	EHD4X48A**	*9MVX100	0.98	0.94	FEM4X48***		1.00	0.96
ED*4X48L**		0.98	0.98	EHD4X48A**	MV16J22**B*	0.98	0.94	FEM4X60***		1.00	0.96
ED*4X60J**	*8MPV100	1.00	0.96	EHD4X48A**	MV20L24**B*	0.98	0.94	FS(M,U)4P48**A*		1.00	1.00
ED*4X60J**	*8MPV125	1.00	0.96	EHD4X48A**		0.98	0.98	FS(M,U)4X48***		0.98	0.98
ED*4X60J**	*9MPV100	1.00	0.96	EHD4X60A**	*8MPV100	1.00	0.96	FS(M,U)4X60**A*		1.00	1.00
ED*4X60J**	*9MVX080	1.00	0.96	EHD4X60A**	*8MPV125	1.00	0.96	FVM4X48***		0.98	0.94
ED*4X60J**	MV16J22**B*	1.00	0.96	EHD4X60A**	*9MPV100	1.00	0.96	FVM4X60***		1.00	0.92
								FXM4X48**A*		1.00	0.96
								FXM4X60**A*		1.00	0.92
(C,H,T)4H360											
*FS(M,U)4X60***		1.00	1.00	ED*4X60L**		0.99	0.99	FEM4X60***		1.01	0.97
ED*4X60J**	*8MPV125	1.00	0.98	EHD4X60A**	*8MPV125	1.00	0.98	FS(M,U)4X60**A*		1.00	1.00
ED*4X60J**	MV16J22**B*	1.01	0.99	EHD4X60A**	MV16J22**B*	1.01	0.95	FVM4X60***		1.02	0.96
ED*4X60J**		0.99	0.99	EHD4X60A**	MV20L24**B*	1.01	0.95	FXM4X60**A*		1.01	0.95
ED*4X60L**	MV20L24**B*	1.01	0.99	EHD4X60A**		1.00	1.00				

> Indicates Tested Indoor Model

HEATING Multiplying Factors for other Indoor Combinations

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
(C,H,T)4H318											
*FS(M,U)4X18****		1.00	1.00	EHD4X24A**	*9MVX040	1.00	0.90	FEM4X24***		0.98	0.91
ED*4X18B**	*8MPV050	0.99	0.94	EHD4X24A**	*9MVX060	1.00	0.90	FS(M,U)4P18**A*		1.00	0.97
ED*4X18B**	MV08B15**B*	0.96	0.94	EHD4X24A**	MV08B15**B*	0.97	0.90	FS(M,U)4P24**A*		1.00	0.96
ED*4X24B**	*8MPV050	1.00	0.90	EHD4X24A**		1.00	0.96	FSA4X18**A*		1.00	1.00
ED*4X24B**	MV08B15**B*	0.97	0.91	EMA4X24D**		1.00	0.96	FSA4X24**A*		1.00	0.99
ED*4X24B**		1.00	0.98	FEA4X18**A*		0.99	0.93	FVM4X24****		0.97	0.90
ED*4X24F**		1.00	0.98	FEA4X24**A*		0.99	0.91	FXM4X18**A*		0.99	0.90
EHD4X24A**	*8MPV050	1.00	0.90	FEM4P18**A*		0.98	0.93	FXM4X24**A*		0.99	0.90
EHD4X24A**	*9MPV050	1.00	0.90	FEM4P24**A*		0.98	0.93				
EHD4X24A**	*9MPV075	1.00	0.90	FEM4X18****		0.98	0.93				
(C,H,T)4H324											
*FS(M,U)4X24****		1.00	1.00	EHD4X24A**	*8MPV075	0.99	0.90	EHD4X30A**	*9MVX040	0.96	0.91
ED*4X24B**	*8MPV050	1.00	0.95	EHD4X24A**	*8MPV100	0.98	0.88	EHD4X30A**	*9MVX060	0.96	0.90
ED*4X24B**	MV08B15**B*	0.98	0.93	EHD4X24A**	*8MPV125	0.98	0.88	EHD4X30A**	*9MVX080	0.93	0.86
ED*4X24B**		1.00	0.98	EHD4X24A**	*9MPV050	0.99	0.92	EHD4X30A**	*9MVX100	0.95	0.88
ED*4X24F**	*8MPV075	1.00	0.93	EHD4X24A**	*9MPV075	0.99	0.93	EHD4X30A**	MV08B15**B*	0.95	0.89
ED*4X24F**	*9MPV050	1.00	0.95	EHD4X24A**	*9MPV100	0.98	0.90	EHD4X30A**	MV12F19**B*	0.95	0.89
ED*4X24F**	*9MPV075	1.00	0.93	EHD4X24A**	*9MPV125	0.99	0.91	EHD4X30A**		0.97	0.95
ED*4X24F**	*9MVX040	0.99	0.95	EHD4X24A**	*9MVX040	0.99	0.94	EMA4X24D**		1.00	0.96
ED*4X24F**	*9MVX060	1.00	0.94	EHD4X24A**	*9MVX060	0.99	0.93	FEA4X24**A*		0.98	0.96
ED*4X24F**	MV12F19**B*	0.98	0.93	EHD4X24A**	*9MVX080	0.99	0.90	FEA4X30**A*		0.98	0.94
ED*4X24F**		1.00	0.98	EHD4X24A**	*9MVX100	0.99	0.91	FEM4P24**A*		0.99	0.97
ED*4X30B**	*8MPV050	0.97	0.91	EHD4X24A**	MV08B15**B*	0.98	0.91	FEM4P30**A*		0.99	0.92
ED*4X30B**	MV08B15**B*	0.96	0.90	EHD4X24A**	MV12F19**B*	0.98	0.91	FEM4X24****		0.99	0.95
ED*4X30B**		0.98	0.96	EHD4X24A**		1.00	0.96	FEM4X30****		0.98	0.91
ED*4X30F**	*8MPV075	0.96	0.88	EHD4X30A**	*8MPV050	0.95	0.90	FS(M,U)4P24**A*		0.99	0.95

> Indicates Tested Indoor Model

- continued on next page -

HEATING Multiplying Factors for other Indoor Combinations (continued)

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
ED*4X30F**	*9MPV050	0.96	0.90	EHD4X30A**	*8MPV075	0.95	0.88	FS(M,U)4P30**A*		0.98	0.94
ED*4X30F**	*9MPV075	0.96	0.90	EHD4X30A**	*8MPV100	0.94	0.86	FS(M,U)4X30***		1.00	0.97
ED*4X30F**	*9MVX040	0.97	0.91	EHD4X30A**	*8MPV125	0.94	0.86	FVM4X24****		0.97	0.90
ED*4X30F**	*9MVX060	0.96	0.89	EHD4X30A**	*9MPV050	0.96	0.91	FVM4X36****		0.96	0.89
ED*4X30F**	MV12F19**B*	0.96	0.90	EHD4X30A**	*9MPV075	0.96	0.91	FXM4X24**A*		0.99	0.92
ED*4X30F**		0.98	0.96	EHD4X30A**	*9MPV100	0.94	0.87	FXM4X30**A*		0.98	0.91
EHD4X24A**	*8MPV050	0.99	0.92	EHD4X30A**	*9MPV125	0.95	0.88				
(C,H,T)4H330											
*FS(M,U)4P30**A*		1.00	1.00	EHD4X30A**	*8MPV100	0.98	0.98	EHD4X36A**	*9MVX060	0.99	0.96
ED*4X30B**	MV08B15**B*	0.97	0.97	EHD4X30A**	*8MPV125	0.98	0.98	EHD4X36A**	*9MVX080	0.99	0.94
ED*4X30F**	*8MPV075	0.99	0.99	EHD4X30A**	*9MPV050	0.98	1.01	EHD4X36A**	*9MVX100	0.99	0.95
ED*4X30F**	*9MPV050	0.99	1.01	EHD4X30A**	*9MPV075	0.98	1.01	EHD4X36A**	MV08B15**B*	0.98	0.95
ED*4X30F**	*9MPV075	0.99	1.01	EHD4X30A**	*9MPV100	0.98	0.99	EHD4X36A**	MV12F19**B*	0.98	0.94
ED*4X30F**	*9MVX040	0.99	1.01	EHD4X30A**	*9MPV125	0.98	0.98	FEA4X30**A*		1.00	1.00
ED*4X30F**	*9MVX060	0.99	1.00	EHD4X30A**	*9MVX040	0.98	1.01	FEA4X36**A*		1.00	1.00
ED*4X30F**	MV12F19**B*	0.98	0.97	EHD4X30A**	*9MVX060	0.98	1.00	FEM4P30**A*		1.00	1.00
ED*4X36B**	MV08B15**B*	0.98	0.98	EHD4X30A**	*9MVX080	0.98	0.97	FEM4P30**A*		1.00	1.00
ED*4X36F**	*8MPV075	0.98	0.97	EHD4X30A**	*9MVX100	0.98	0.99	FEM4P36**A*		1.00	1.00
ED*4X36F**	*9MPV050	0.98	1.00	EHD4X30A**	MV08B15**B*	0.98	0.97	FEM4P36**A*		1.00	1.00
ED*4X36F**	*9MPV075	0.98	0.99	EHD4X30A**	MV12F19**B*	0.98	0.97	FEM4X30***		0.99	0.98
ED*4X36F**	*9MVX040	0.98	1.00	EHD4X36A**	*8MPV050	1.00	0.98	FEM4X36***		0.97	0.94
ED*4X36F**	*9MVX060	0.98	0.98	EHD4X36A**	*8MPV075	0.99	0.95	FS(M,U)4P30**A*		1.00	1.00
ED*4X36F**	MV12F19**B*	0.98	0.97	EHD4X36A**	*8MPV100	0.99	0.94	FVM4X24****		0.98	0.97
ED*4X36J**	*8MPV100	0.98	0.95	EHD4X36A**	*8MPV125	0.99	0.94	FVM4X36***		0.97	0.96
ED*4X36J**	*8MPV125	0.98	0.95	EHD4X36A**	*9MPV050	0.99	0.98	FVM4X48***		0.98	0.93
ED*4X36J**	*9MPV100	0.98	0.96	EHD4X36A**	*9MPV075	0.99	0.97	FXM4X30**A*		0.97	0.95
ED*4X36J**	*9MVX080	0.98	0.95	EHD4X36A**	*9MPV100	0.99	0.95	FXM4X36**A*		1.00	0.95

> Indicates Tested Indoor Model

- continued on next page -

HEATING Multiplying Factors for other Indoor Combinations (continued)											
Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
EHD4X30A**	*8MPV050	0.98	1.00	EHD4X36A**	*9MPV125	0.99	0.95				
EHD4X30A**	*8MPV075	0.98	0.99	EHD4X36A**	*9MVX040	0.99	0.98				
(C,H,T)4H336											
*FS(M,U)4P36**A*		1.00	1.00	ED*4X42J**		0.99	1.00	EHD4X42A**	*9MPV125	0.97	0.90
ED*4X36B**	*8MPV050	0.97	1.01	ED*4X42L**	*9MPV125	0.97	0.93	EHD4X42A**	*9MVX040	0.97	0.95
ED*4X36B**	MV08B15**B*	0.97	0.96	ED*4X42L**	*9MVX100	0.97	0.94	EHD4X42A**	*9MVX060	0.97	0.93
ED*4X36B**		0.99	1.02	ED*4X42L**	MV20L24**B*	0.97	0.93	EHD4X42A**	*9MVX080	0.97	0.90
ED*4X36F**	*8MPV075	0.97	0.97	ED*4X42L**		0.97	0.98	EHD4X42A**	*9MVX100	0.97	0.91
ED*4X36F**	*9MPV050	0.97	1.00	EHD4X36A**	*8MPV050	0.99	1.00	EHD4X42A**	MV08B15**B*	0.97	0.91
ED*4X36F**	*9MPV075	0.97	0.99	EHD4X36A**	*8MPV075	0.97	0.94	EHD4X42A**	MV12F19**B*	0.97	0.91
ED*4X36F**	*9MVX040	0.97	1.00	EHD4X36A**	*8MPV100	0.97	0.91	EHD4X42A**	MV16J22**B*	0.97	0.90
ED*4X36F**	*9MVX060	0.97	0.98	EHD4X36A**	*8MPV125	0.97	0.91	EHD4X42A**	MV20L24**B*	0.97	0.91
ED*4X36F**	MV12F19**B*	0.97	0.95	EHD4X36A**	*9MPV050	0.97	0.97	EHD4X42A**		0.97	0.94
ED*4X36F**		0.99	1.01	EHD4X36A**	*9MPV075	0.97	0.96	EMA4X36D**		0.99	1.01
ED*4X36J**	*8MPV100	0.97	0.94	EHD4X36A**	*9MPV100	0.97	0.93	FEA4X36**A*		1.00	1.02
ED*4X36J**	*8MPV125	0.97	0.94	EHD4X36A**	*9MPV125	0.97	0.92	FEM4P36**A*		1.00	1.00
ED*4X36J**	*9MPV100	0.97	0.95	EHD4X36A**	*9MVX040	0.97	0.97	FEM4P36**A*		1.00	1.00
ED*4X36J**	*9MVX080	0.97	0.95	EHD4X36A**	*9MVX060	0.97	0.95	FEM4P42**A*		1.00	0.94
ED*4X36J**	MV16J22**B*	0.97	0.94	EHD4X36A**	*9MVX080	0.97	0.92	FEM4P42**A*		1.00	0.94
ED*4X36J**		1.00	1.02	EHD4X36A**	*9MVX100	0.97	0.93	FEM4X36****		0.99	0.94
ED*4X42F**	*8MPV075	0.97	0.95	EHD4X36A**	MV08B15**B*	0.97	0.93	FEM4X42****		1.00	0.95
ED*4X42F**	*9MPV050	0.97	0.98	EHD4X36A**	MV12F19**B*	0.97	0.92	FS(M,U)4P36**A*		1.00	1.00
ED*4X42F**	*9MPV075	0.97	0.97	EHD4X36A**	MV16J22**B*	0.97	0.92	FS(M,U)4P42**A*		1.00	0.97
ED*4X42F**	*9MVX040	0.97	0.99	EHD4X36A**	MV20L24**B*	0.97	0.92	FS(M,U)4P42**A*		0.99	0.96
ED*4X42F**	*9MVX060	0.97	0.97	EHD4X36A**		0.99	0.98	FS(M,U)4X42****		1.00	1.00
ED*4X42F**	MV12F19**B*	0.97	0.94	EHD4X42A**	*8MPV050	0.97	0.96	FSM4X36****		1.00	0.99
ED*4X42F**		0.99	1.00	EHD4X42A**	*8MPV075	0.97	0.92	FVM4X24****		0.97	0.96

> Indicates Tested Indoor Model

- continued on next page -

HEATING Multiplying Factors for other Indoor Combinations (continued)

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
ED*4X42J**	*8MPV100	0.97	0.93	EHD4X42A**	*8MPV100	0.97	0.90	FVM4X36***		0.97	0.95
ED*4X42J**	*8MPV125	0.97	0.92	EHD4X42A**	*8MPV125	0.97	0.89	FVM4X48***		0.97	0.90
ED*4X42J**	*9MPV100	0.97	0.94	EHD4X42A**	*9MPV050	0.97	0.95	FXM4X36**A*		1.00	0.93
ED*4X42J**	*9MVX080	0.97	0.94	EHD4X42A**	*9MPV075	0.97	0.94	FXM4X42**A*		1.00	0.93
ED*4X42J**	MV16J22**B*	0.97	0.93	EHD4X42A**	*9MPV100	0.97	0.91				
(C,H,T)4H342											
*FS(M,U)4P42**A*		1.00	1.00	ED*4X48J**		0.99	0.99	EHD4X48A**	*9MVX060	0.99	0.99
ED*4X42F**	*8MPV075	0.96	0.99	ED*4X48L**	*9MPV125	0.99	0.97	EHD4X48A**	*9MVX080	0.99	0.96
ED*4X42F**	MV12F19**B*	0.96	0.97	ED*4X48L**	*9MVX100	0.99	0.97	EHD4X48A**	*9MVX100	0.99	0.97
ED*4X42F**		1.00	1.03	ED*4X48L**	MV20L24**B*	0.96	0.93	EHD4X48A**	MV12F19**B*	0.96	0.93
ED*4X42J**	*8MPV100	0.96	0.96	ED*4X48L**		0.99	0.99	EHD4X48A**	MV16J22**B*	0.96	0.92
ED*4X42J**	*8MPV125	0.96	0.96	EHD4X42A**	*8MPV075	0.99	0.98	EHD4X48A**	MV20L24**B*	0.96	0.92
ED*4X42J**	*9MPV100	0.96	0.98	EHD4X42A**	*8MPV100	0.99	0.96	EHD4X48A**		0.99	0.98
ED*4X42J**	*9MVX080	0.99	1.00	EHD4X42A**	*8MPV125	0.99	0.96	EMA4X48D**		0.99	1.00
ED*4X42J**	MV16J22**B*	0.96	0.96	EHD4X42A**	*9MPV075	0.99	1.01	FEM4P42**A*		0.99	0.98
ED*4X42J**		0.99	1.02	EHD4X42A**	*9MPV100	0.99	0.97	FEM4P42**A*		0.99	0.98
ED*4X42L**	*9MPV125	0.96	0.97	EHD4X42A**	*9MPV125	0.99	0.97	FEM4P48**A*		0.99	0.97
ED*4X42L**	*9MVX100	0.96	0.97	EHD4X42A**	*9MVX060	0.99	1.00	FEM4P48**A*		0.98	0.96
ED*4X42L**	MV20L24**B*	0.96	0.96	EHD4X42A**	*9MVX080	0.99	0.97	FEM4X42***		0.98	0.97
ED*4X42L**		0.99	1.02	EHD4X42A**	*9MVX100	0.99	0.97	FEM4X48***		0.99	0.95
ED*4X48F**	*8MPV075	0.99	0.98	EHD4X42A**	MV12F19**B*	0.96	0.93	FS(M,U)4P42**A*		1.00	1.00
ED*4X48F**	*9MPV075	0.99	1.00	EHD4X42A**	MV16J22**B*	0.96	0.93	FS(M,U)4P48**A*		0.99	0.97
ED*4X48F**	*9MVX060	0.99	0.99	EHD4X42A**	MV20L24**B*	0.96	0.93	FS(M,U)4P48**A*		0.99	0.97
ED*4X48F**	MV12F19**B*	0.96	0.92	EHD4X42A**		0.99	0.99	FS(M,U)4X42***		0.99	1.02
ED*4X48F**		0.99	0.98	EHD4X48A**	*8MPV075	0.99	0.98	FS(M,U)4X48***		0.99	0.99
ED*4X48J**	*8MPV100	0.99	0.96	EHD4X48A**	*8MPV100	0.99	0.95	FVM4X36***		0.96	0.98
ED*4X48J**	*8MPV125	0.99	0.96	EHD4X48A**	*8MPV125	0.99	0.95	FVM4X48***		0.96	0.93

> Indicates Tested Indoor Model

- continued on next page -

HEATING Multiplying Factors for other Indoor Combinations (continued)

Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)	Indoor Model	Furnace Model	Capac. (MBh)	Power (AMPS)
ED*4X48J**	*9MPV100	0.99	0.98	EHD4X48A**	*9MPV075	0.99	1.00	FXM4X42**A*		0.99	0.97
ED*4X48J**	*9MVX080	0.99	0.97	EHD4X48A**	*9MPV100	0.99	0.97				
ED*4X48J**	MV16J22**B*	0.96	0.93	EHD4X48A**	*9MPV125	0.99	0.96				
(C,H,T)4H348											
*FS(M,U)4P48**A*		1.00	1.00	ED*4X60L**	*9MPV125	0.97	0.97	EHD4X60A**	*9MVX100	0.97	0.96
ED*4X48F**		1.00	1.03	ED*4X60L**	*9MVX100	0.97	0.97	EHD4X60A**	MV16J22**B*	0.97	0.94
ED*4X48J**	*8MPV100	0.97	0.98	ED*4X60L**	MV20L24**B*	0.97	0.95	EHD4X60A**	MV20L24**B*	0.97	0.94
ED*4X48J**	*8MPV125	0.97	0.98	ED*4X60L**		1.00	1.01	EHD4X60A**		1.00	1.00
ED*4X48J**	*9MPV100	0.97	0.99	EHD4X48A**	*8MPV100	0.97	0.97	FEM4P48**A*		0.97	0.99
ED*4X48J**	*9MVX080	0.97	0.99	EHD4X48A**	*8MPV125	0.97	0.97	FEM4P48**A*		0.97	0.99
ED*4X48J**	MV16J22**B*	0.97	0.96	EHD4X48A**	*9MPV100	0.97	0.98	FEM4P60**A*		0.99	0.98
ED*4X48J**		1.00	1.02	EHD4X48A**	*9MPV125	0.97	0.98	FEM4P60**A*		0.99	0.98
ED*4X48L**	*9MPV125	0.97	0.98	EHD4X48A**	*9MVX080	0.97	0.98	FEM4X48***		1.00	0.99
ED*4X48L**	*9MVX100	0.97	0.99	EHD4X48A**	*9MVX100	0.97	0.98	FEM4X60***		0.99	0.95
ED*4X48L**	MV20L24**B*	0.97	0.96	EHD4X48A**	MV16J22**B*	0.97	0.95	FS(M,U)4P48**A*		0.97	0.97
ED*4X48L**		1.00	1.02	EHD4X48A**	MV20L24**B*	0.97	0.95	FS(M,U)4X48***		0.97	1.00
ED*4X60J**	*8MPV100	0.97	0.96	EHD4X48A**		1.00	1.01	FS(M,U)4X60**A*		1.00	1.01
ED*4X60J**	*8MPV125	0.97	0.96	EHD4X60A**	*8MPV100	0.97	0.95	FVM4X48***		0.97	0.96
ED*4X60J**	*9MPV100	0.97	0.98	EHD4X60A**	*8MPV125	0.97	0.94	FVM4X60***		0.97	0.93
ED*4X60J**	*9MVX080	0.97	0.98	EHD4X60A**	*9MPV100	0.97	0.96	FXM4X48**A*		0.97	0.95
ED*4X60J**	MV16J22**B*	0.97	0.95	EHD4X60A**	*9MPV125	0.97	0.96	FXM4X60**A*		0.99	0.94
ED*4X60J**		1.00	1.01	EHD4X60A**	*9MVX080	0.97	0.96				
(C,H,T)4H360											
*FS(M,U)4X60***		1.00	1.00	ED*4X60L**		0.99	0.99	FEM4X60***		0.98	0.95
ED*4X60J**	*8MPV125	0.99	0.98	EHD4X60A**	*8MPV125	1.01	0.99	FS(M,U)4X60**A*		1.00	1.00
ED*4X60J**	MV16J22**B*	0.98	0.96	EHD4X60A**	MV16J22**B*	0.99	0.96	FVM4X60***		0.98	0.94
ED*4X60J**		0.99	0.99	EHD4X60A**	MV20L24**B*	0.99	0.95	FXM4X60**A*		0.98	0.94
ED*4X60L**	MV20L24**B*	0.98	0.96	EHD4X60A**		1.00	1.00				

> Indicates Tested Indoor Model